

Installation Manual
(Translation of original
instructions)

EN



innova

N420943A - Rev.01 - 04/24

>OSMO<

ECA844 - EWA844 - ESE845 ESE846
- EEB749 - EFB749 -EGB749 -
B10842 - B4V842 - B3V151

First of all, we would like to thank you for having chosen a device of our production.

We are sure you will be happy with it because it represents the state of the art in the technology of home air conditioning.

By following the suggestions contained in this manual, the product you have purchased will operate without problems giving you optimum room temperatures with minimum energy costs.

INNOVA S.r.l.

Conformity

Refer to the Installation Manual of the paired unit.

Markings



TABLE OF CONTENTS

1	Coding	<u>p. 6</u>
1.1	Coding accessories	<u>p. 6</u>
2	General information	<u>p. 7</u>
2.1	About the manual.	<u>p. 7</u>
2.1.1	Editorial pictograms	<u>p. 7</u>
2.1.2	Pictograms on the product.	<u>p. 7</u>
2.1.3	Recipients	<u>p. 7</u>
2.1.4	Manual organisation	<u>p. 7</u>
2.2	General warnings	<u>p. 8</u>
2.3	Basic rules of security	<u>p. 8</u>
2.4	Disposal.	<u>p. 9</u>
3	Touchpad and remote control Code ECA844	<u>p. 10</u>
3.1	Interface	<u>p. 10</u>
3.2	Description.	<u>p. 10</u>
3.3	Electronic board ECA844	<u>p. 11</u>
3.4	Connections	<u>p. 12</u>
3.4.1	Presence contact CP	<u>p. 12</u>
3.5	Functions.	<u>p. 12</u>
3.5.1	Basic menu	<u>p. 12</u>
3.5.2	Advanced Menu	<u>p. 13</u>
3.5.3	Error signals	<u>p. 13</u>
3.5.4	Visualization of alarms on display	<u>p. 13</u>
4	Touchpad and remote control Code EWA844.	<u>p. 14</u>
4.1	Interface	<u>p. 14</u>
4.2	Description.	<u>p. 14</u>
4.3	EWA844 electronic board.	<u>p. 15</u>
4.4	Connections	<u>p. 15</u>
4.4.1	Presence contact CP	<u>p. 15</u>
4.5	Functions.	<u>p. 16</u>
4.5.1	Basic menu	<u>p. 16</u>
4.5.2	Advanced Menu	<u>p. 16</u>
4.5.3	Error signals	<u>p. 17</u>
4.5.4	Visualization of alarms on display	<u>p. 17</u>
5	Preparation for connecting wall controls	<u>p. 18</u>
5.1	Preliminary warnings.	<u>p. 18</u>
5.2	Preparation for command connection	<u>p. 18</u>
5.2.1	Preliminary warnings	<u>p. 18</u>
5.2.2	Device preparation	<u>p. 18</u>

5.2.3	Installation of electrical connection box	<u>p. 19</u>
5.2.4	Connection of MOTOR connector	<u>p. 19</u>
5.2.5	Completed assembly	<u>p. 19</u>
5.2.6	Version configurations	<u>p. 20</u>
5.2.7	Models with right-hand hydraulic connections	<u>p. 20</u>
5.2.8	Access to the terminal block	<u>p. 20</u>

6 M7 series control Code EEB749 p. 21

6.1	Interface	<u>p. 21</u>
6.2	Installation.	<u>p. 21</u>
6.2.1	Description	<u>p. 21</u>
6.2.2	Mounting	<u>p. 21</u>
6.3	Single connection diagram	<u>p. 23</u>
6.4	Multiple connection diagram	<u>p. 24</u>
6.5	Connections	<u>p. 25</u>
6.5.1	Preliminary warnings	<u>p. 25</u>
6.5.2	Control Panel	<u>p. 25</u>
6.5.3	Presence contact CP	<u>p. 25</u>
6.5.4	RS485 Serial Connection.	<u>p. 26</u>
6.6	Functions.	<u>p. 26</u>
6.6.1	Basic menu	<u>p. 26</u>
6.6.2	Advanced Menu	<u>p. 27</u>
6.6.3	Pairing of control and unit	<u>p. 27</u>
6.6.4	Error signals	<u>p. 28</u>
6.6.5	Alarm display on wall control panel	<u>p. 29</u>

7 M7 series control Part No. EFB749 p. 30

7.1	Interface	<u>p. 30</u>
7.2	Installation.	<u>p. 30</u>
7.2.1	Description	<u>p. 30</u>
7.2.2	Mounting	<u>p. 30</u>
7.3	Single connection diagram	<u>p. 32</u>
7.4	Multiple connection diagram	<u>p. 33</u>
7.5	Connections	<u>p. 34</u>
7.5.1	Preliminary warnings	<u>p. 34</u>
7.5.2	Control Panel	<u>p. 34</u>
7.5.3	Presence contact CP	<u>p. 34</u>
7.5.4	RS485 Serial Connection.	<u>p. 35</u>
7.6	Functions.	<u>p. 35</u>
7.6.1	Basic menu	<u>p. 35</u>
7.6.2	Advanced Menu	<u>p. 36</u>
7.6.3	Pairing of control and unit	<u>p. 37</u>
7.6.4	Error signals	<u>p. 38</u>
7.6.5	Alarm display on wall control panel	<u>p. 38</u>

8 M7 series control Code EGB749 p. 39

8.1	Interface	<u>p. 39</u>
8.2	Installation.	<u>p. 39</u>
8.2.1	Description	<u>p. 39</u>

8.2.2	Mounting	<u>p. 39</u>
8.3	Single connection diagram	<u>p. 41</u>
8.4	Multiple connection diagram	<u>p. 42</u>
8.5	Connections	<u>p. 43</u>
8.5.1	Preliminary warnings	<u>p. 43</u>
8.5.2	Control Panel	<u>p. 43</u>
8.5.3	Presence contact CP	<u>p. 43</u>
8.5.4	Bluetooth connection	<u>p. 44</u>
8.6	Functions	<u>p. 44</u>
8.6.1	Basic menu	<u>p. 44</u>
8.6.2	Advanced Menu	<u>p. 45</u>
8.6.3	Pairing of control and unit	<u>p. 46</u>
8.6.4	Error signals	<u>p. 47</u>
8.6.5	Visualization of alarms on display	<u>p. 47</u>
9	On-board electronic board B4V642 + wall control B3V151	<u>p. 48</u>
9.1	Interface	<u>p. 48</u>
9.2	Description	<u>p. 48</u>
9.3	Connection diagram	<u>p. 49</u>
9.4	Connection diagram with seasonal switching	<u>p. 50</u>
9.5	Connection diagram	<u>p. 51</u>
9.6	Connections	<u>p. 52</u>
9.6.1	Connection with 3 speed thermostats	<u>p. 52</u>
9.7	LED signal	<u>p. 52</u>
10	Connection 0-10 V Code B10842	<u>p. 53</u>
10.1	Installation	<u>p. 53</u>
10.1.1	Description	<u>p. 53</u>
10.2	Connection diagram	<u>p. 53</u>
10.3	Connections with 0-10 V thermostats	<u>p. 53</u>
10.4	LED signal	<u>p. 54</u>






CODING

⚠ The present manual refers to the products:

- >OSMO< SL
- >OSMO< RS

1.1 Coding accessories

This instruction manual refers to the following accessory codes.

	Accessory description	Combinable products	Code
Controls on the appliance			
M7 controls			
	M7 on-board electronic control with continuously modulating thermostat	All	ECA844II
	M7 on-board electronic control with continuously modulating thermostat, with built-in WiFi module.	All	EWA844II
Wall-mounted control panels M7 series			
Printed circuit board M7			
	Electronic board on board unit with continuous modulation. For connection to M7 wall control units	All	ESE845II
	Electronic board on board unit with continuous modulation. For connection to M7 wall control with Bluetooth	All	ESE846II
Control panels			
	LED electronic control panel with touch interface, wall-mounted complete with thermostat and room temperature and relative humidity probe. Cable connection. Colour white	All	EEB749II
	LED electronic control panel with touch interface, wall-mounted complete with thermostat and room temperature and relative humidity probe with integrated WiFi module, InnovAPP. Cable connection. Colour white	All	EFB749II
	LED electronic control panel with touch interface, wall-mounted complete with thermostat and room temperature and relative humidity probe. Bluetooth connection. Colour white	All	EGB749II
WALL MOUNTED STANDARD FANCOIL CONTROLS			
PCB			
	On-board electronic printed circuit board for control from systems with 0-10 V analogue output.	All	B10842II
	On-board electronic printed circuit board for connection to 3-speed wall-mounted electromechanical thermostats.	All	B4V842II
Control panels			
	Wall mounted control with thermostat, summer/winter and speed selectors	All	B3V151II

GENERAL INFORMATION

2.1 About the manual

This manual was written to provide all the explanations for the correct management of the appliance.

⚠ This instruction manual forms an integral part of the device and therefore must be carefully preserved and must ALWAYS travel with it, even if you transfer the device to another owner or relocate it to other premises. If the manual gets damaged or lost, download a copy from the website.

⚠ Read this manual carefully before proceeding with any operation and follow the instructions in the individual chapters.

⚠ The manufacturer is not responsible for damages to persons or property caused by failure to follow the instructions in this manual.

⚠ This document is restricted in use to the terms of the law and may not be copied or transferred to third parties without the express authorization of the manufacturer.

2.1.1 Editorial pictograms

The pictograms in the next chapter provide the necessary information for correct, safe use of the machine in a rapid, unmistakable way.

Related to security

⚠ High risk warning (bold text)

- The operation described above presents a risk of serious physical injury, fatality, major damage to the appliance and/or to the environment if not carried out in compliance with safety regulations.

⚠ Low risk warning (plain text)

- The operation described above presents a risk of minor physical injury or minor damage to the appliance and/or to the environment if not carried out in compliance with safety regulations.

⊘ Prohibition (plain text)

- Refers to prohibited actions.

i Important information (bold text)

- This indicates important information that must be taken into account during the operations.

In the texts

- procedures
- lists

In the control panels

- actions required
- Expected responses following an action.*

In the figures

- 1 The numbers indicate the individual components.

A The capital letters indicate component assemblies.

1 The white numbers in black marks indicate a series of actions to be carried out in sequence.

(A) The black letter in white identifies an image when there are several images in the same figure.

2.1.2 Pictograms on the product

Symbols are used in some parts of the appliance:

Related to security

⚠ Caution: electrical danger

- The concerned personnel is informed to the presence of electricity and the risk of suffering an electric shock.

2.1.3 Recipients

User

Non-expert person capable of operating the product in safe conditions for people, for the product itself and the environment, interpreting an elementary diagnostic of faults and abnormal operating conditions, carrying out simple adjustment, checking and maintenance operations.

Installer

Expert person qualified to position and connect (hydraulically, electrically, etc.) the unit to the plant; this person is responsible for handling and correct installation according to the instructions provided in this manual and the national standards currently in force.

Technical Service Centre

Expert and qualified person authorised directly by the manufacturer to carry out all routine and supplementary maintenance operations, as well as every adjustment, check, repair and replacement of parts necessary during the life of the unit itself.

2.1.4 Manual organisation

The manual is divided into sections each dedicated to one or more target groups.

Coding

It addresses all recipients.

It contains the list of products and/or accessories referred to in the manual.

General information

It addresses all recipients.

It contains general information and important warnings that should be known before installing and using the appliance.

Installation

It is addressed exclusively to the installer.

It contains specific warnings and all the information necessary for positioning, mounting and connecting the appliance.

Control panels

It is addressed only and exclusively to the Installer and the Technical Assistance Centre.

These are sections dedicated to the different types of controls and electronic boards combined with the range with specific information for that combination.

2.2 General warnings

- ⚠ Specific warnings are given in each chapter of the document and must be read before starting operations.
- ⚠ All personnel involved must be aware of the operations and dangers that may arise when beginning all unit installation operations.
- ⚠ Installation performed outside the warnings provided in this manual and use of the appliance outside the prescribed temperature limits will invalidate the warranty.
- ⚠ The installation and maintenance of climate control equipment could be dangerous because there is live electrical components inside the appliances. The installation, initial start-up and subsequent maintenance phases must be carried out exclusively by authorised and qualified personnel (see first start-up request form enclosed with the appliance).
- ⚠ Any contractual or extra-contractual liability for damage caused to persons, animals or property, due to installation, adjustment and maintenance errors or improper use is excluded. All uses not expressly indicated in this manual are not permitted.
- ⚠ Only qualified installer companies are authorised to install the device. After having completed installation, the installer will issue a declaration of conformity to the plant manager, as required by the applicable standards and the guidelines provided by contractor's instruction manual supplied with the device.
- ⚠ First start-up and repair or maintenance operations must be carried out by the Technical Assistance Centre or by qualified personnel following the provisions of this manual.
- ⚠ Do not modify or tamper with the appliance as this can lead to dangerous situations.
- ⚠ Use suitable accident-prevention clothing and equipment during installation and/or maintenance operations. The manufacturer is not liable for the non-observance of the current safety and accident prevention regulations.
- ⚠ In the event of liquid or oil leaks, set the master switch of the plant to "off" and close the water taps. Call the authorised Technical Assistance Centre or professionally qualified personnel as soon as possible and do not work on the appliance yourself.
- ⚠ In case of replacement of parts, use only original parts.
- ⚠ The manufacturer reserves the right to make changes to its models at any time to improve its product, without prejudice to the essential characteristics described in this manual. The manufacturer is not obliged to add such modifications to machines previously manufactured, already delivered or under construction.
- ⚠ The unit can be used by children over the age of 8, and by people with reduced physical, sensory or mental capabilities, or with no experience or necessary knowledge, as long as they are monitored or after they have received instructions on the safe use of the unit and have understood the dangers involved. Children must not play with the appliance. The cleaning and maintenance that must be performed by the user should not be carried out by children without supervision.

2.3 Basic rules of security

Please keep in mind that the use of products powered by electricity and water call for operators to comply with certain essential safety rules:

- ⊖ The use of the appliance to children and unassisted disabled persons is prohibited.
- ⊖ It is forbidden to touch the device with wet or damp body parts.
- ⊖ It is forbidden to carry out any operation before disconnecting the appliance from the power supply by setting the plant master switch to "off".
- ⊖ It is forbidden to modify the safety or adjustment devices or adjust without authorization and indications of the manufacturer.
- ⊖ It is forbidden to pull, unplug or twist the device's electric cables, even if it is disconnected from the mains.
- ⊖ It is forbidden to introduce objects and substances through the air inlet and outlet grilles.
- ⊖ It is forbidden to open the access doors of the device's internal parts without first having set main switch of the system to "off".
- ⊖ It is forbidden to dispose of, or leave in the reach of children, the packaging materials which could become a source of danger.

2.4 Disposal



The symbol on the product or its packaging indicates that the product must not be treated as normal household waste, but must be taken to the appropriate collection point for the recycling of electrical and electronic equipment.

Proper disposal of this product avoids harm to humans and the environment and promotes the reuse of valuable raw materials.

For more detailed information about the recycling of this product, contact your local city office, your household waste disposal service or the shop where you purchased the product.

Illegal disposal of the product by the user involves the application of the administrative sanctions provided for by the regulations in force.


This provision is only valid in the EU Member States.

TOUCHPAD AND REMOTE CONTROL CODE ECA844

3.1 Interface

The touchpad control is supplied as standard on board the unit and does not require any connections.

1. Display area
2. Keys area

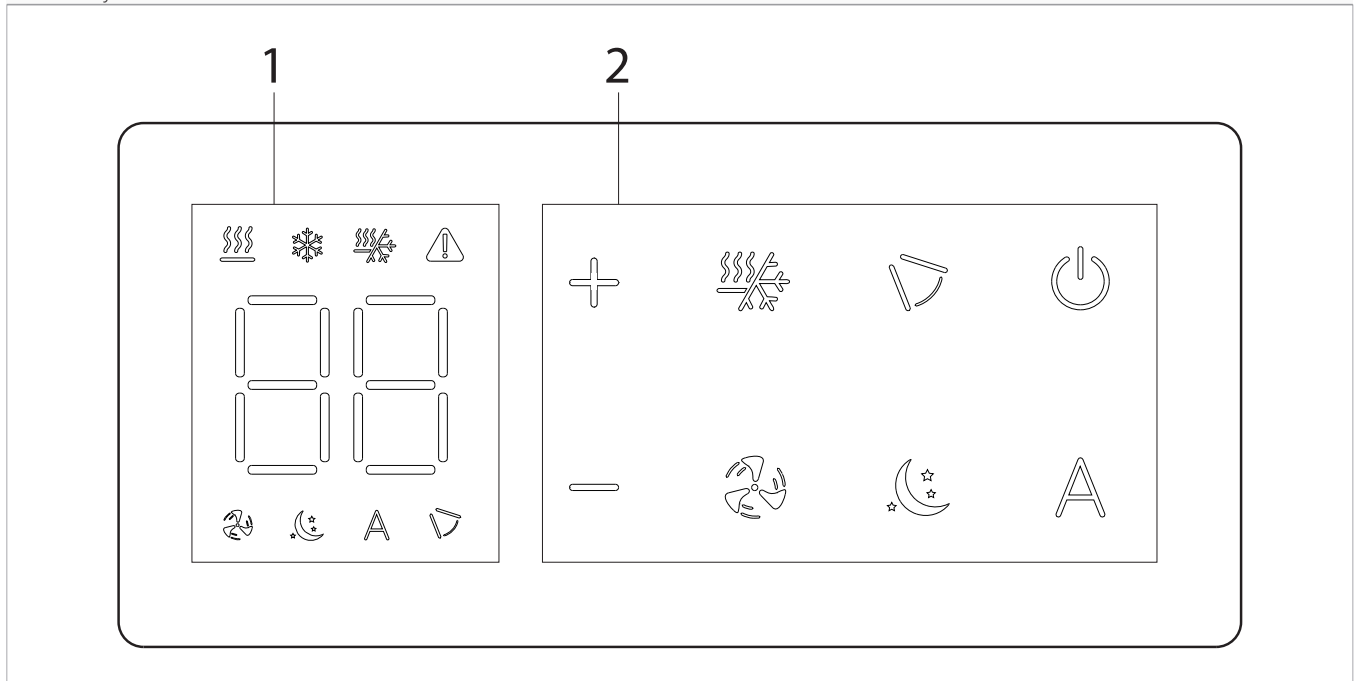

3.2 Description


ECA044- M7 on-board control with built-in Wi-Fi module, with continuously modulating thermostat and remote control supplied as standard.

3.3 Electronic board ECA844

The PCB is included in the supply.

M1	Fan motor DC Inverter
PE	Earth connection
L-N	Power supply connection 230 V / 50 Hz / 1 A
Y1	Water electrovalve
CH/C1	Cooling request contact (for example chiller or reversible heat pump). Activated in parallel with the solenoid valve output (Y1) with 1 minute delay when the fancoil is in cooling mode and is on call (potential-free contact max. 1 A).
BO/C2	Heating request contact (for example boiler or heat pump). Activated in parallel with the output of the solenoid valve (Y1)

CP	Presence contact (normally open)
IN1	Input for potential-free contact 1
AIR/T1	Air temperature probe
H2/T2	Water temperature probe
DU	Touchpad
PU	Electronic board on the unit

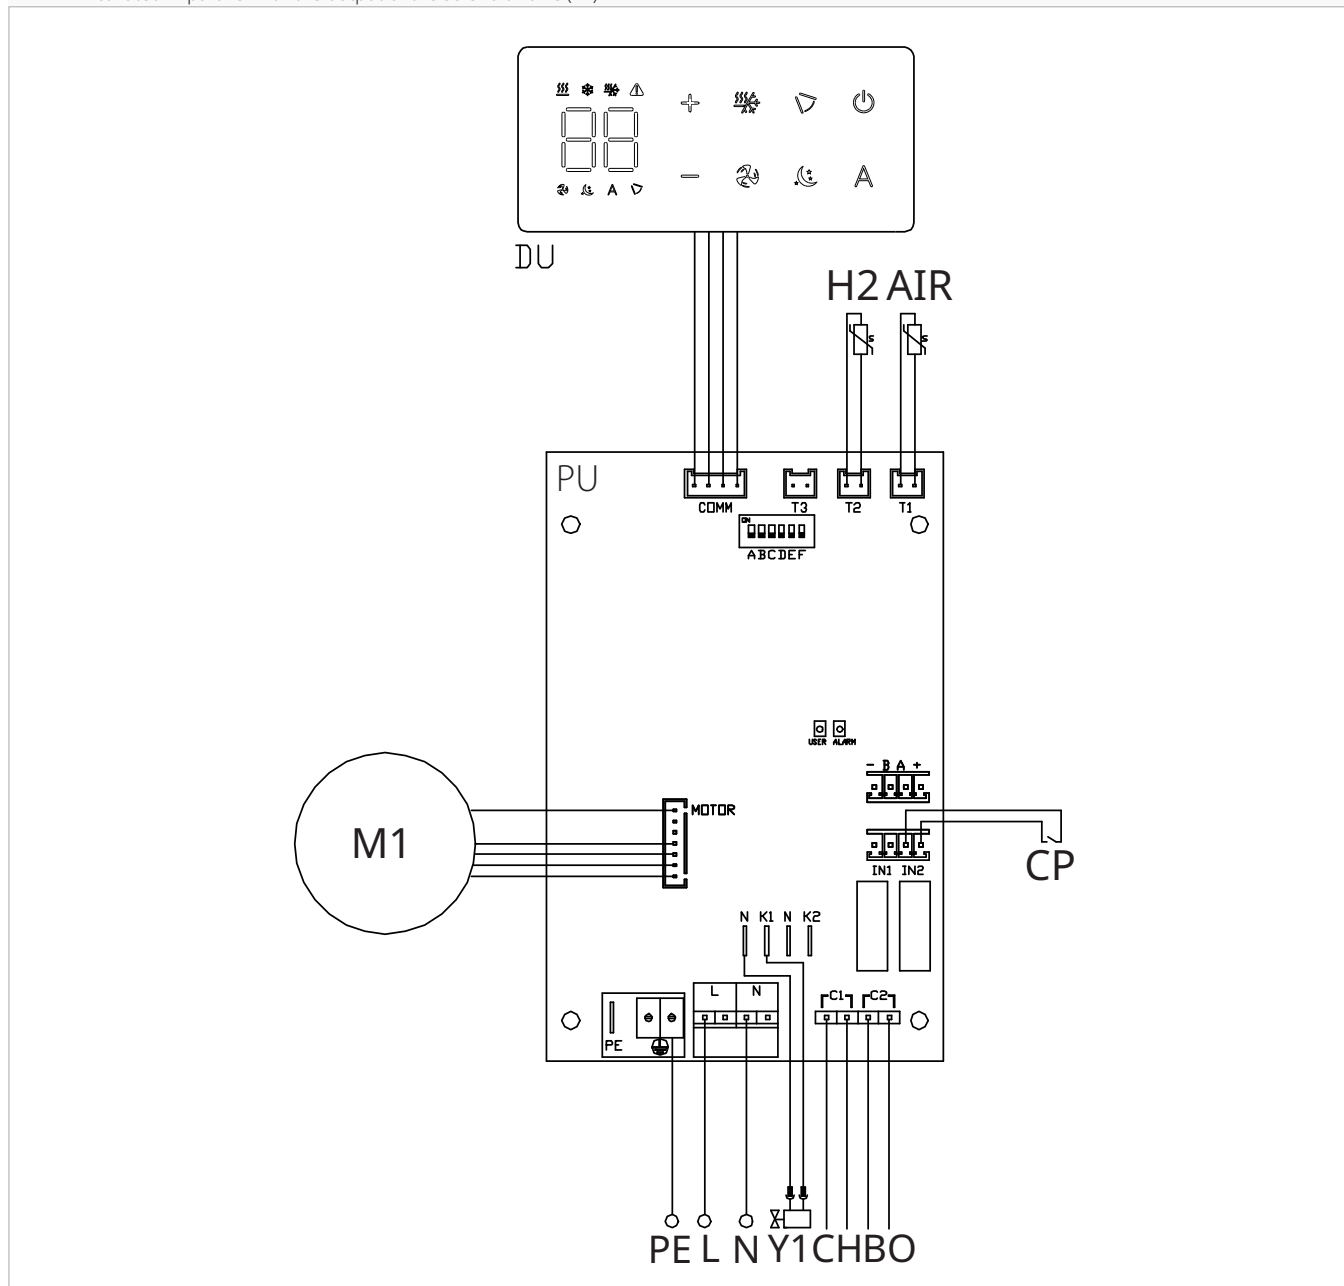

Through the water temperature probe H2/T2 (10 k Ω) located in the thermowell on the unit's coil, the temperature setpoints for fan stop are controlled:

- minimum temperature in heating mode (30 °C)
- maximum temperature in cooling mode (20 °C)

⚠ The printed circuit board provides for operation without a water probe. In this case, the fan stop thresholds are ignored.

3.4 Connections


3.4.1 Presence contact CP


Trough this contact it is possible connect an external device that inhibits the operation of the device, for example:

- opening window contact
- remote on/off
- infrared presence sensor
- enabling badge
- remote change of season

Function

The contact is normally open.


- when closing the CP contact, connected to a potential-free contact, the device switches to stand-by mode
CP appears on the display.
- At the touch of a button on the display the symbol  flashes.

 It is forbidden connect in parallel the CP input to one of another electronic board. Use separate contacts. The CP presence contact can be configured for heating and cooling operation via the "To select digital input" [p. 13](#) settings menu item (digital input).



3.5 Functions


3.5.1 Basic menu

To access the basic menu



- with the display off, hold down  for 10 seconds

The device turns on and  appears

- keep pressed until the indication  appears
- release the  key

The symbol  appears


To navigate in the menu

- use the icons  

To select a menu item and to confirm the changes made

- press the icon 
- Confirming the change takes you to the next item.*

To exit the menu

- press the icon  for 10 seconds
- or wait 30 seconds the automatic shutdown

Menu items

ot: AIR probe offset (air probe setting)




CF: Scale

ub: Buzzer volume






uu: Not used

uP: Not used

3.5.1.1 Set AIR probe offset




 The set value changes by 1 °C each press of the  and  buttons.

To set the air probe regulation

- select 
- press  to change settings
- increase or decrease the value with the icons  
- press  to confirm
*By default it is set to 0.
The range of settings is from a minimum of -9°C to a maximum of +9°C.*






Scale

To change the temperature unit of measure

- select 
- press  to change settings
- select °C o °F
- press  to confirm
By default the temperature unit of measure is °C.

Adjusting buzzer volume

To change the volume

- select 
- press  to change settings
- increase or decrease the value with the icons  
- press  to confirm
The volume setting range is from 00 (min) to 03 (max).





 The volume changes after confirm the modification.

3.5.2 Advanced Menu



⚠ To access the Setup menu, it is necessary to access the Basic menu. See section "Basic menu" p. 12.

The special functions menu can be accessed via the control panel.


To access the setup menu

- from the basic menu press **A**
Appears 
- press the  key once
Appears 
- press  to confirm and log in
This takes you to the settings menu.




To navigate in the menu

- use the icons  

To select a menu item and to confirm the changes made

- press  for 2 seconds
Confirming the change takes you to the next item.

To exit the menu

- press  for about 10 seconds
Appears 
- press  for about 10 seconds
The display turns off.
- or wait 30 seconds after the last action
The display is switched off automatically.

⚠ After 30 seconds from the last action the control goes out and the settings is memorized.

Menu items

Ad: Not used

of: Options for digital output

UC: Not used




Ac: Not used

Ah: Not used


Fr: Not used

To select digital input

To change the digital input


- select 
- press  to change settings
- select CP for contact presence (default)
- select CO to cooling open
- select CC to cooling close
- press  to confirm
By default digital input is set to CP.

⚠ For return to the default settings, set the digital input to "CP".

⚠ By selecting one of the other inputs (CO,CC) the seasonality is locked. It is not possible to modify it through the key  of the control.

3.5.3 Error signals

The PCB has a status LED.

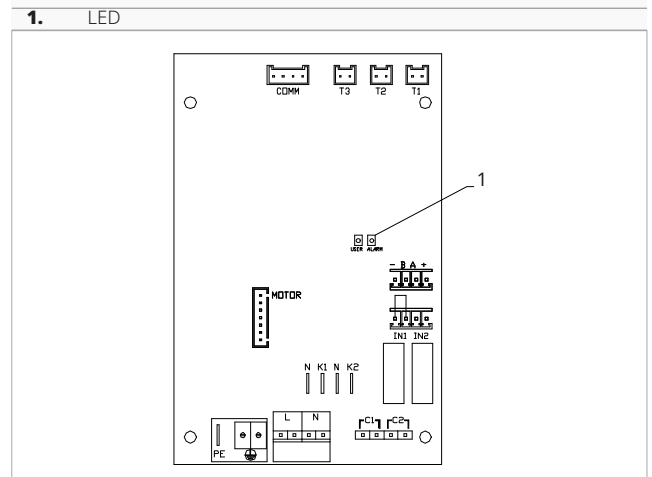

⚠ The flashing LED indicates errors.

⚠ It is possible to verify the meaning of the LEDs by means of the error code displayed on the touchpad.




⚠ To identify the error, please refer to "Visualization of alarms on display" p. 13.

⚠ With the LED on and no indication on the display, it is indicated that there are no errors.

3.5.4 Visualization of alarms on display

⚠ In the event of a malfunction, the display shows an alarm code.

⚠ In the event of an alarm, the device still maintains active functions.


- E1 Room temperature probe AIR/T1 disconnected or faulty
None of the modes can be activated.
- E2 Faulty internal fan motor or disconnected
None of the modes can be activated.
- E3 Water temperature probe H2/T2 disconnected or failure
None of the modes can be activated.
- CE Communication error
Errors in the communication between the touchpad control and the board. None of the modes can be activated.
The symbol  appears to indicate unsuitable radiant water.
-  lampeggiante Incorrect water temperature
In heating mode, the water temperature is below 30 °C.
-  lampeggiante Incorrect water temperature
In cooling mode, the water temperature is above 20 °C.

TOUCHPAD AND REMOTE CONTROL CODE EWA844

4.1 Interface

The touchpad control is supplied as standard on board the unit and does not require any connections.

1. Display area
2. Keys area

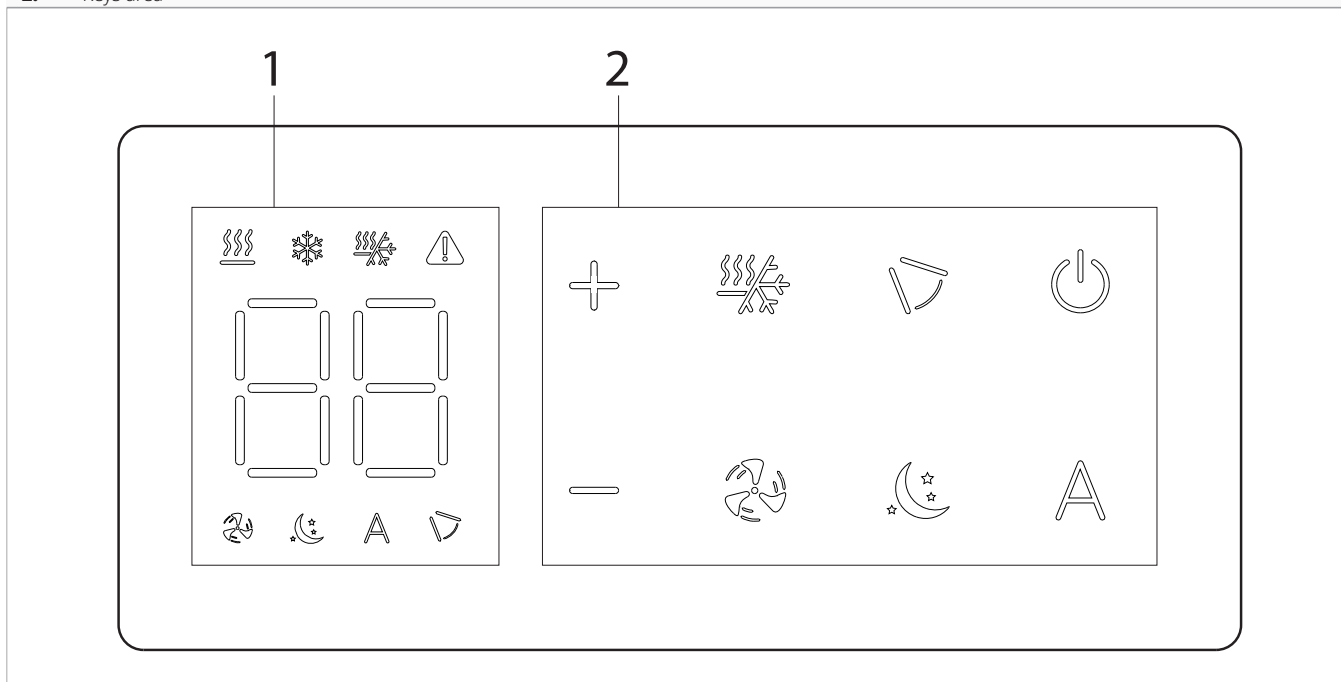

4.2 Description

EWA044- M7 on-board control with built-in Wi-Fi module, with continuously modulating thermostat and remote control supplied as standard.


⚠ For the M7cod. EWA844 machine control, the INNOVA app is available.

4.3 EWA844 electronic board

The PCB is included in the supply.

M1	Fan motor DC Inverter
PE	Earth connection
L-N	Power supply connection 230 V / 50 Hz / 1 A
Y1	Water electrovalve
CH/C1	Cooling request contact (for example chiller or reversible heat pump). Activated in parallel with the solenoid valve output (Y1) with 1 minute delay when the fancoil is in cooling mode and is on call (potential-free contact max. 1 A).
BO/C2	Heating request contact (for example boiler or heat pump). Activated in parallel with the output of the solenoid valve (Y1)

CP	Presence contact (normally open)
IN1	Input for potential-free contact 1
AIR/T1	Air temperature probe
H2/T2	Water temperature probe
DU	Touchpad
PU	Electronic board on the unit
WF	Card for Wi-Fi connection

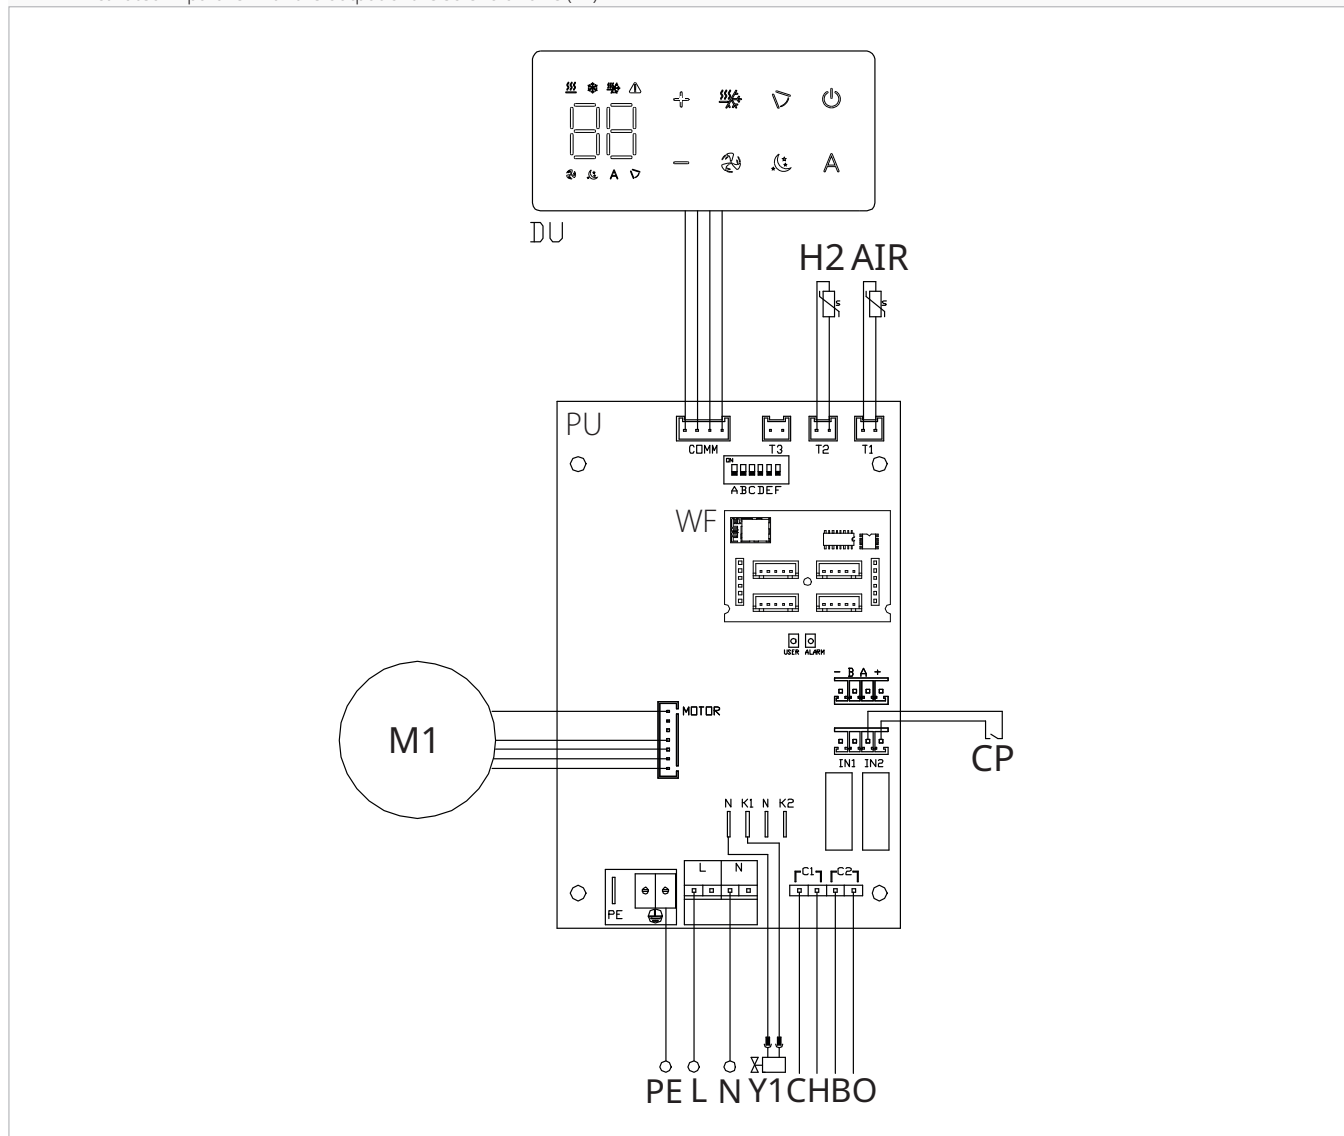

Through the water temperature probe H2/T2 (10 k Ω) located in the thermowell on the unit's coil, the temperature setpoints for fan stop are controlled:

- minimum temperature in heating mode (30 °C)

- maximum temperature in cooling mode (20 °C)

⚠ The printed circuit board provides for operation without a water probe. In this case, the fan stop thresholds are ignored.

4.4 Connections

4.4.1 Presence contact CP

Through this contact it is possible to connect an external device that inhibits the operation of the device, for example:


- opening window contact

- remote on/off
- infrared presence sensor
- enabling badge
- remote change of season

Function

The contact is normally open.

- when closing the CP contact, connected to a potential-free contact, the device switches to stand-by mode
CP appears on the display.


- At the touch of a button on the display the symbol  flashes.


- ⊖ It is forbidden connect in parallel the CP input to one of another electronic board. Use separate contacts. The CP presence contact can be configured for heating and cooling operation via the "To select digital input" [p. 13](#) settings menu item (digital input).



4.5 Functions

4.5.1 Basic menu

To access the basic menu



- with the display off, hold down  for 10 seconds

The device turns on and  appears


- keep pressed until the indication  appears
- release the  key

The symbol  appears

To navigate in the menu


- use the icons  

To select a menu item and to confirm the changes made

- press the icon 

Confirming the change takes you to the next item.

To exit the menu

- press the icon  for 10 seconds
- or wait 30 seconds the automatic shutdown

Menu items

ot: AIR probe offset (air probe setting)



CF: Scale

ub: Buzzer volume






uu: Wi-Fi reset

uP: Wi-Fi pairing

Set AIR probe offset




- ⚠ The set value changes by 1 °C each press of the  and  buttons.

To set the air probe regulation

- select 
- press  to change settings
- increase or decrease the value with the icons  
- press  to confirm
By default it is set to 0.
The range of settings is from a minimum of -9°C to a maximum of +9°C.






Scale

To change the temperature unit of measure

- select 
- press  to change settings
- select °C or °F
- press  to confirm
By default the temperature unit of measure is °C.

Adjusting buzzer volume










To change the volume

- select 
- press  to change settings
- increase or decrease the value with the icons  
- press  to confirm
The volume setting range is from 00 (min) to 03 (max).

- ⚠ The volume changes after confirm the modification.










Wi-Fi reset

To reset the Wi-Fi credentials and return the device to its original configuration

- select 
- press  to change settings
- use the   icons in sequence
Appears 
- press  
 appears to reset Wi-Fi credentials.
- press  to confirm
Credentials have been reset.

Activate Wi-Fi

To activate Wi-Fi

- select 
- press  to change settings
- use the   icons in sequence
Appears 
- press  
 appears to enable Wi-Fi pairing.
- press  to confirm





- ⚠ The device remains visible on the INNOVA App for the first 15 minutes after the device is switched on.

4.5.2 Advanced Menu



- ⚠ To access the Setup menu, it is necessary to access the Basic menu. See section "Basic menu" [p. 12](#).

The special functions menu can be accessed via the control panel.


To access the setup menu

- from the basic menu press **A**
Appears 
- press the  key once
Appears 
- press  to confirm and log in
This takes you to the settings menu.




To navigate in the menu


- use the icons  

To select a menu item and to confirm the changes made

- press  for 2 seconds
Confirming the change takes you to the next item.

To exit the menu

- press  for about 10 seconds
Appears 
- press  for about 10 seconds
The display turns off.
- or wait 30 seconds after the last action
The display is switched off automatically.

 After 30 seconds from the last action the control goes out and the settings is memorized.

Menu items

Ad: Not used

of: Options for digital output




UC: Not used


Ac: Not used



Ah: Not used

Fr: Not used

To select digital input**To change the digital input**

- select 
- press  to change settings
- select CP for contact presence (default)
- select CO to cooling open
- select CC to cooling close
- press  to confirm
By default digital input is set to CP.


 For return to the default settings, set the digital input to "CP".


 By selecting one of the other inputs (CO,CC) the seasonality is locked. It is not possible to modify it through the key  of the control.


4.5.3 Error signals

The PCB has a status LED.

 The flashing LED indicates errors.


 It is possible to verify the meaning of the LEDs by means of the error code displayed on the touchpad.




 To identify the error, please refer to "Visualization of alarms on display" [p. 17](#).

 With the LED on and no indication on the display, it is indicated that there are no errors.

4.5.4 Visualization of alarms on display

 In the event of a malfunction, the display shows an alarm code.

 In the event of an alarm, the device still maintains active functions.

- E1 Room temperature probe AIR/T1 disconnected or faulty
None of the modes can be activated.
- E2 Faulty internal fan motor or disconnected
None of the modes can be activated.
- E3 Water temperature probe H2/T2 disconnected or failure
None of the modes can be activated.
- CE Communication error
Errors in the communication between the touchpad control and the board. None of the modes can be activated.
The symbol  appears to indicate unsuitable radiant water.
-  lampeggiante Incorrect water temperature
In heating mode, the water temperature is below 30 °C.
-  lampeggiante Incorrect water temperature
In cooling mode, the water temperature is above 20 °C.

PREPARATION FOR CONNECTING WALL CONTROLS

5.1 Preliminary warnings

⚠ The following procedure is required to connect the wall controls (EEB749II - EFB749II - EGB749II - B3V151II - B10842II).

5.2 Preparation for command connection

5.2.1 Preliminary warnings

- ⚠ Before doing any work, make sure that the supply power is disconnect.
- ⚠ All operations of an electrical nature must be carried out by qualified personnel having the necessary legal requirements, trained and informed about the risks related to such operations.
- ⚠ All connections must be made following the regulations in force in the country of installation.


- ⚠ The unit must only be powered after work has been completed.
- ⚠ Disconnect the main breaker before making any electrical connections and performing any type of operation.
- ⚠ Access to the electrical panel is only permitted to qualified personnel.
- ⚠ Refer to the respective section of the control used to make the electrical connections.

5.2.2 Device preparation

Before proceeding with the installation, it is necessary to remove some elements from the appliance.

1. Fixing screws
2. Upper grid

3. Cover cabinet

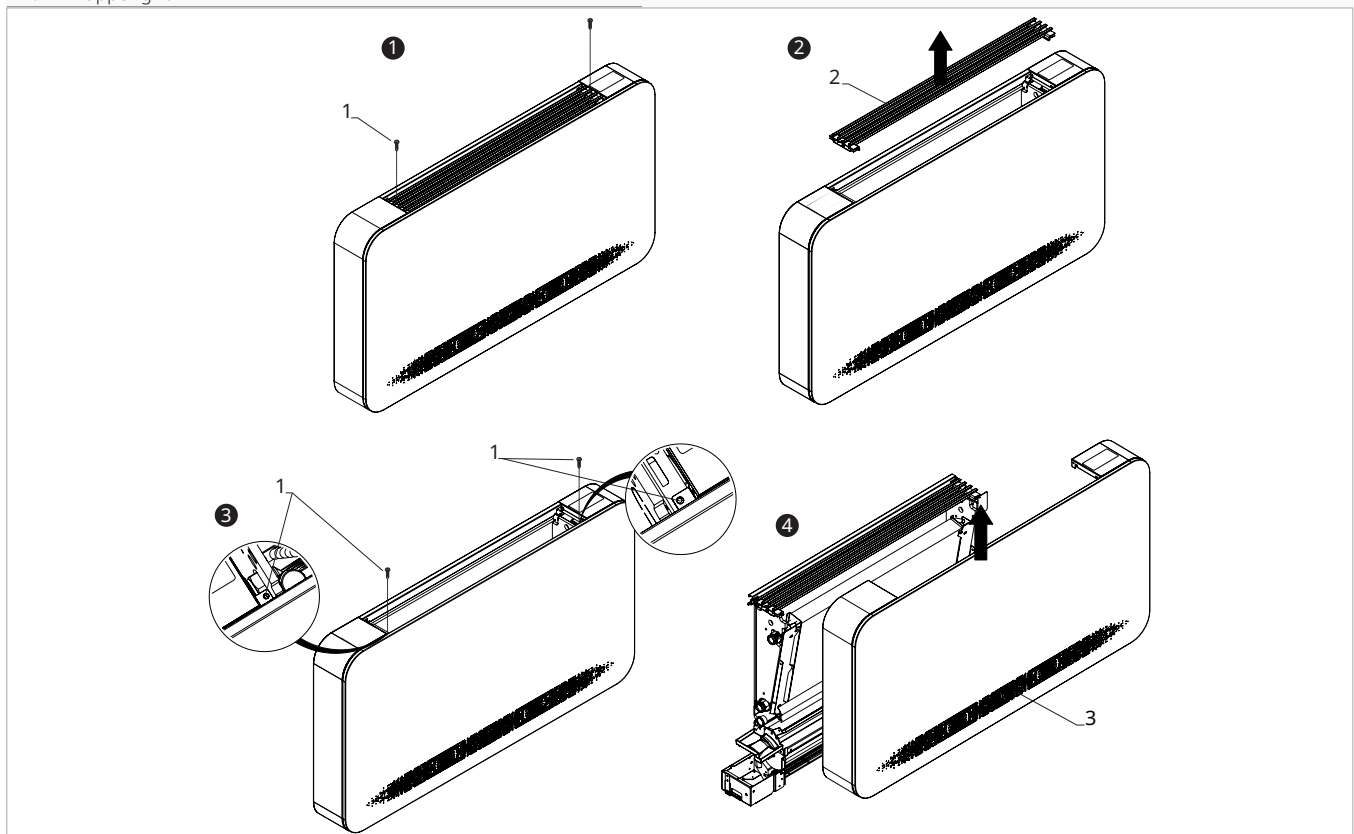

to remove the grid

- remove the fixing screws
- lift up and remove the upper grille

To remove the cover cabinet

- remove the fixing screws

- lift the cover cabinet

- Disconnect the on-board display connector (if present)

- remove the cover cabinet


5.2.3 Installation of electrical connection box

⚠ Normally the unit leaves the factory with the electrical box mounted.

⚠ In exceptional cases, the electrical box can be installed at a later stage.

- | | |
|----|----------------|
| 1. | Electrical box |
| 2. | Notches |
| 3. | Holes |

- | | |
|----|---------------------------|
| 4. | Fixing screws |
| 5. | Cable strain relief clamp |
| 6. | Fixing of ground cable |

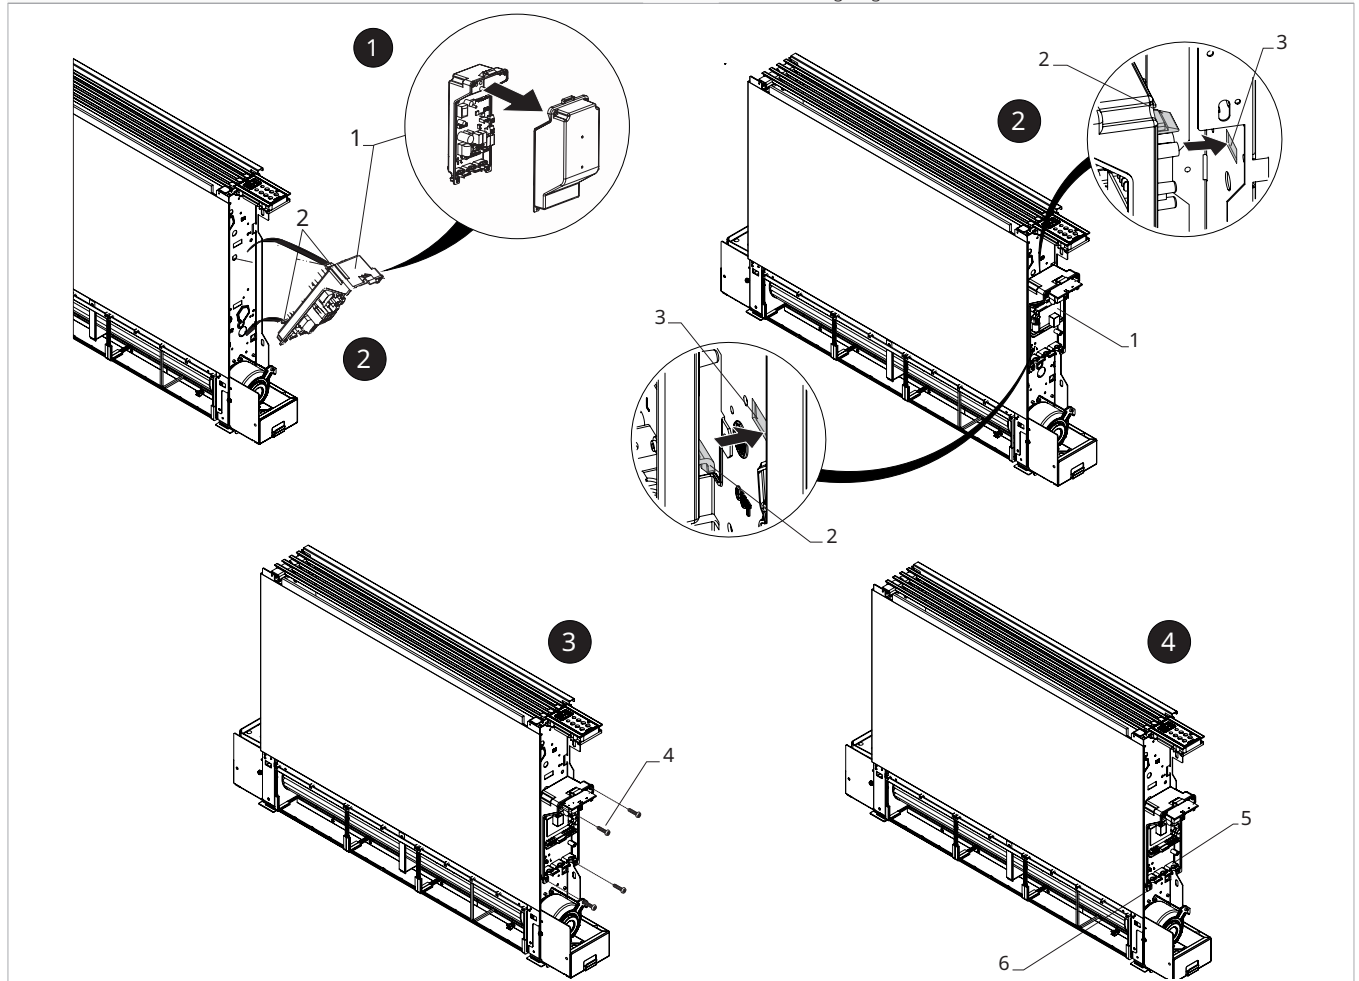

In this case, to install the electrical box:

- open the electrical box
- place the base of the electrical box on the side of the appliance
- Wedge the notches of the electrical box into the appropriate holes on the side of the appliance
- fix the electrical box with the fixing screws provided

⚠ The minimum force that must be exerted for starting must be about 2 N.

- connect the connectorto the MOTOR quick connector on the printed circuit board
- connect the water probe to the T2 connector on the device

⚠ The water temperature probe monitors the temperature inside the coils and determines fan start-up according to preset parameters. (winter minimum and summer maximum functions)

⚠ Check that the probe is correctly positioned in the compartment on the coil.

- connect the electrics
- tidy up the cables
- fix the cables using the grommets provided
- close the electrical box
- fix the electrical box with the fixing screws provided

5.2.4 Connection of MOTOR connector

To connect the MOTOR connector

- connect the motor quick connector (MOTOR) to the connector on the printed circuit board

5.2.5 Completed assembly

Completed assembly

- place the cover of the electrical box
- fix with screws
- reassemble the cover cabinet

- fix with screws

5.2.6 Version configurations

RS versions

In RS versions to control the radiant effect of the front panel make the connections.

To make the connections

- connect the appropriate connector to the expansion board and the output of the Y1 solenoid valve

⚠ Refer to the "Electrical Connections" sections of the specific printed circuit boards for connections.

5.2.8 Access to the terminal block

- 1. Fixing screws
- 2. Cover of the electrical box


5.2.7 Models with right-hand hydraulic connections

The fancoils in the >OSMO< range are designed with:

- hydraulic coil connections on the left side of the unit
- electrical connections on the right side of the unit

⚠ Should it be necessary to invert the position of the coil's hydraulic connections from the left (default) side to the right side, the hydraulic Hydraulic connection reversal kit must be used to make the electrical connections to the fan motor and the grid safety microswitch.

- 3. Terminal block for wiring

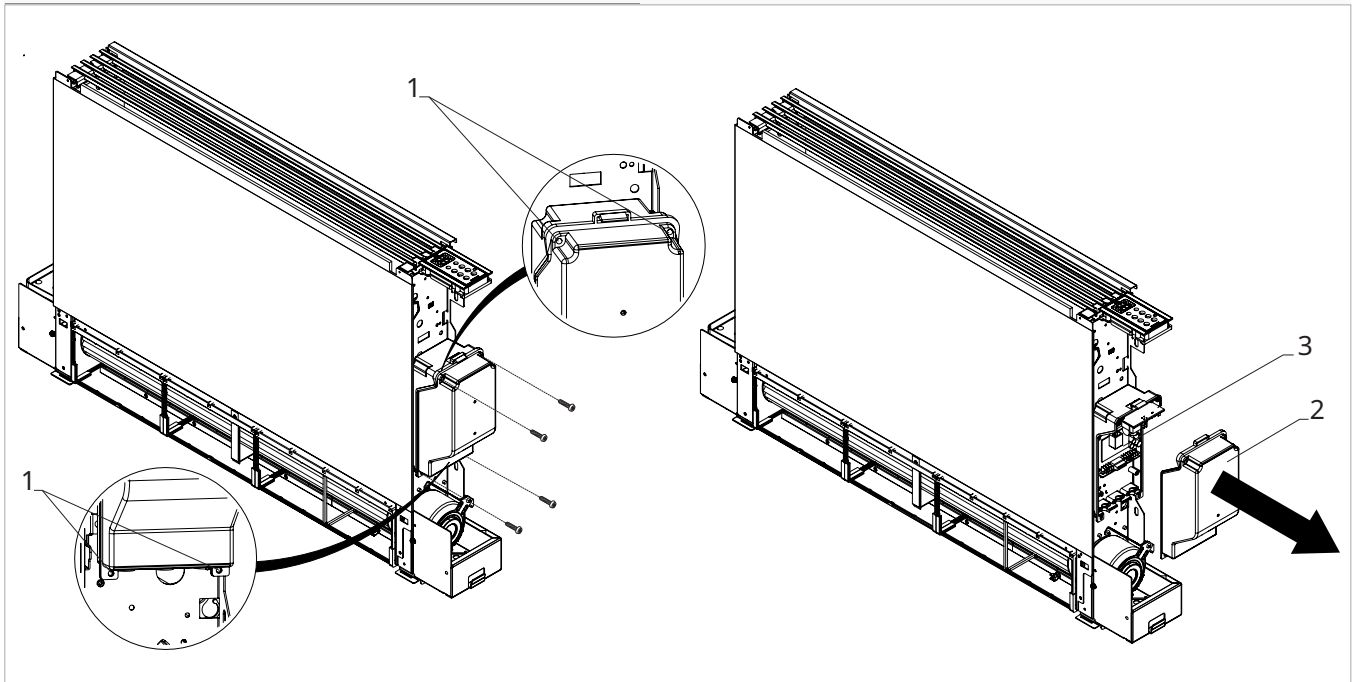

⚠ Before doing any work, make sure that the supply power is disconnect.

To access:

- if installed, remove the movable cover panel
- Disconnect the on-board display connector (if present)

To access the connections:

- unscrew the fixing screws of the electric box
- remove the lid from the junction box

⚠ Refer to the information in the wiring diagram of the unit you are installing.

⚠ Please refer to the sections of the respective controls for indications of electrical connections.


⚠ The electrical connection can be made by a cable recessed into the wall as indicated on the installation template (connection recommended for installation of the device at the top of the wall).

⚠ It is necessary to check that the power supply is provided with appropriate protection against electric shorts and/or overloads

M7 SERIES CONTROL CODE EEB749

6.1 Interface

1. Display area
2. Keys area

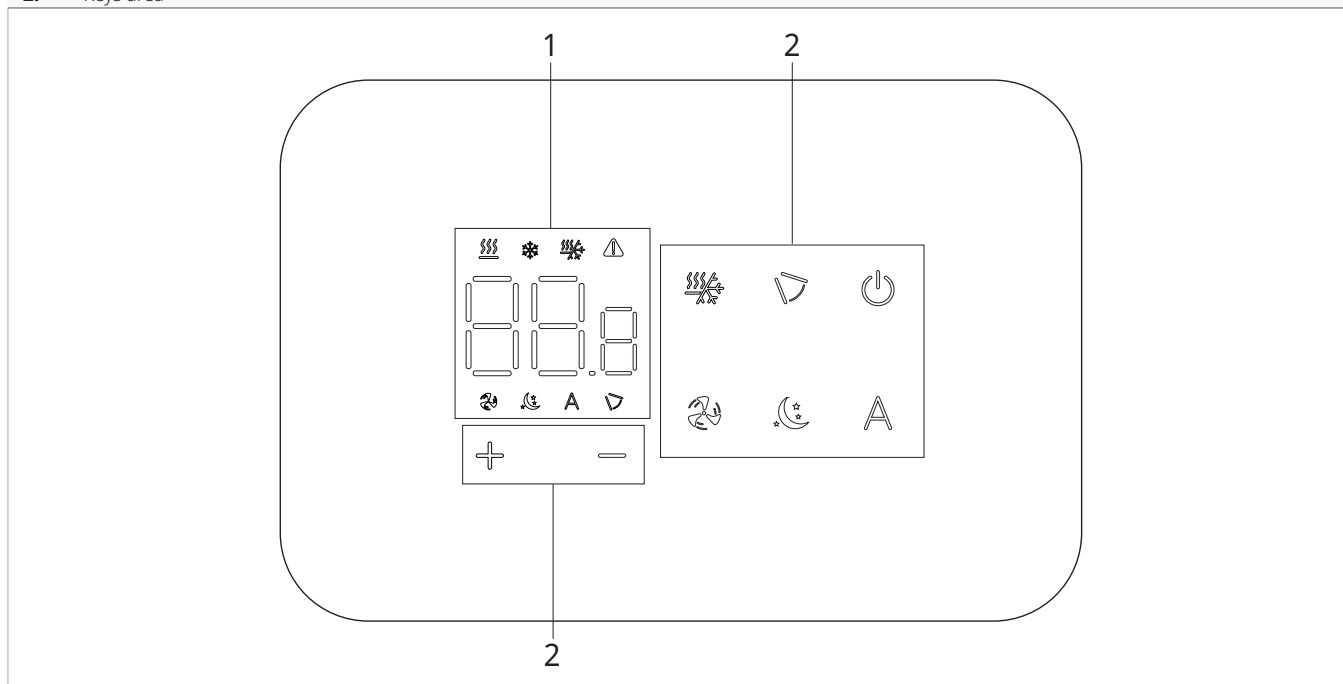

6.2 Installation

6.2.1 Description


the wall-mounted remote control is an electronic LED thermostat with a touch interface, with the possibility of control over multiple appliances equipped with the same electronic board. It is equipped with a temperature and humidity probe.

⚠ The control can control up to a maximum of 16 units.

6.2.2 Mounting

⚠ The control panel for wall control is to be installed inside a 503 electrical box.

⚠ A wall must be prepared to accommodate the 503 electrical box before installing the wall control.

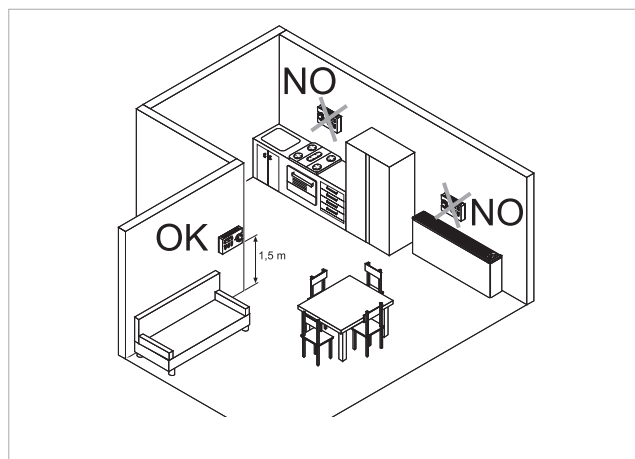


The wall-mounted remote control must be installed:

- on internal walls
- at a height of about 1,5 m from the floor
- away from doors or windows
- away from heat sources (heaters, convectors, stoves, direct sunlight)

⚠ The wall control is provided inside the package already assembled.

1. Base of control
2. Wall-mounted control panel

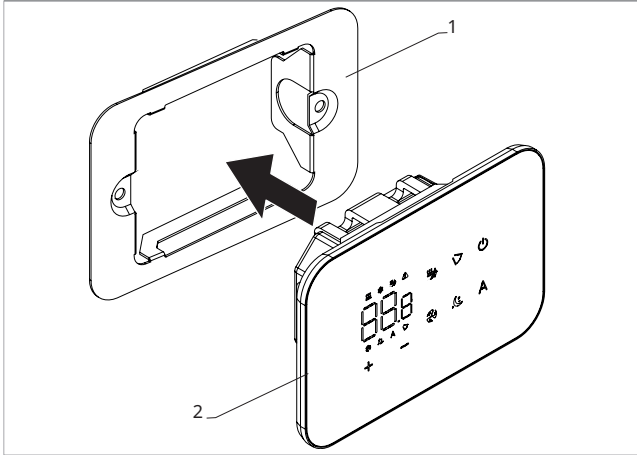


- Close the control panel

⚠ Pay attention not to crush the conductors when you close the control.

Before wall installation:

- separate the control base from the control panel

1. Fixing screws
2. Base of control
3. Holes for fixing to electrical box
4. Electric box 503

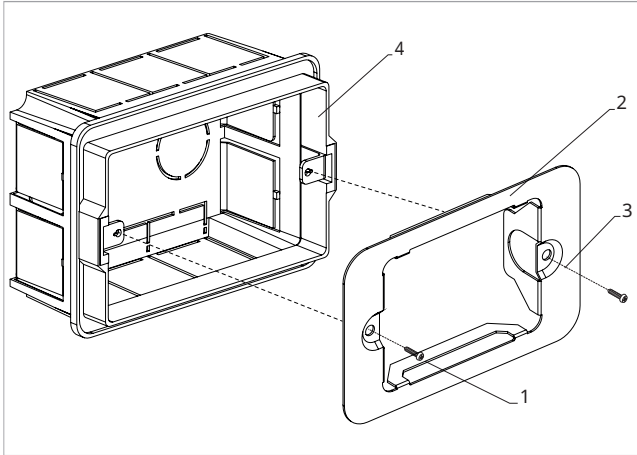


For wall mounting of the control panel:

- fix the control base to the electrical box 503 with screws
- connect the electrics

⚠ Before making the connections, please verify that the control terminal block is on the right-hand side.


1. Electric box 503
2. Base of control
3. Wall-mounted control panel

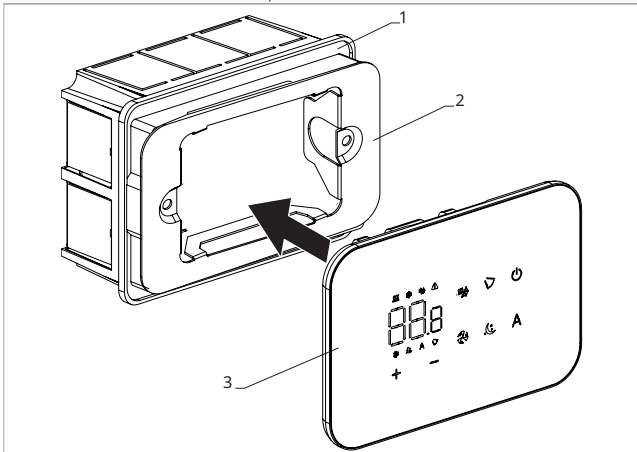

6.3 Single connection diagram

M1	Fan motor DC Inverter
PE	Earth connection
L-N	Power supply connection 230 V / 50 Hz / 1 A
Y1	Water electrovalve (voltage output 230 V / 50 Hz / 1 A)
CH/C1	Cooling request contact (for exemple chiller or reversible heat pump). Activated in parallel with the solenoid valve output (Y1) with 1 minute delay when the fancoil is in cooling mode and is on call (potential-free contact max. 1 A).
BO/C2	Heating request contact (for example boiler or heat pump). Activated in parallel with the output of the solenoid valve (Y1)

	with 1 minute delay when the fancoil is in heating mode and is on call (potential-free contact max. 1 A).
CP	Presence contact (normally open)
-BA+	Serial connection for wall-mounted remote control (respect polarisation AB)
IN1	Potential-free input 1(not active)
H2/T2	2-pipe water temperature probe
RS	RS version wiring
HRS	water probe RS version (10 kΩ)
LU	Electronic board for pairing control and device
PU	Electronic board on the unit

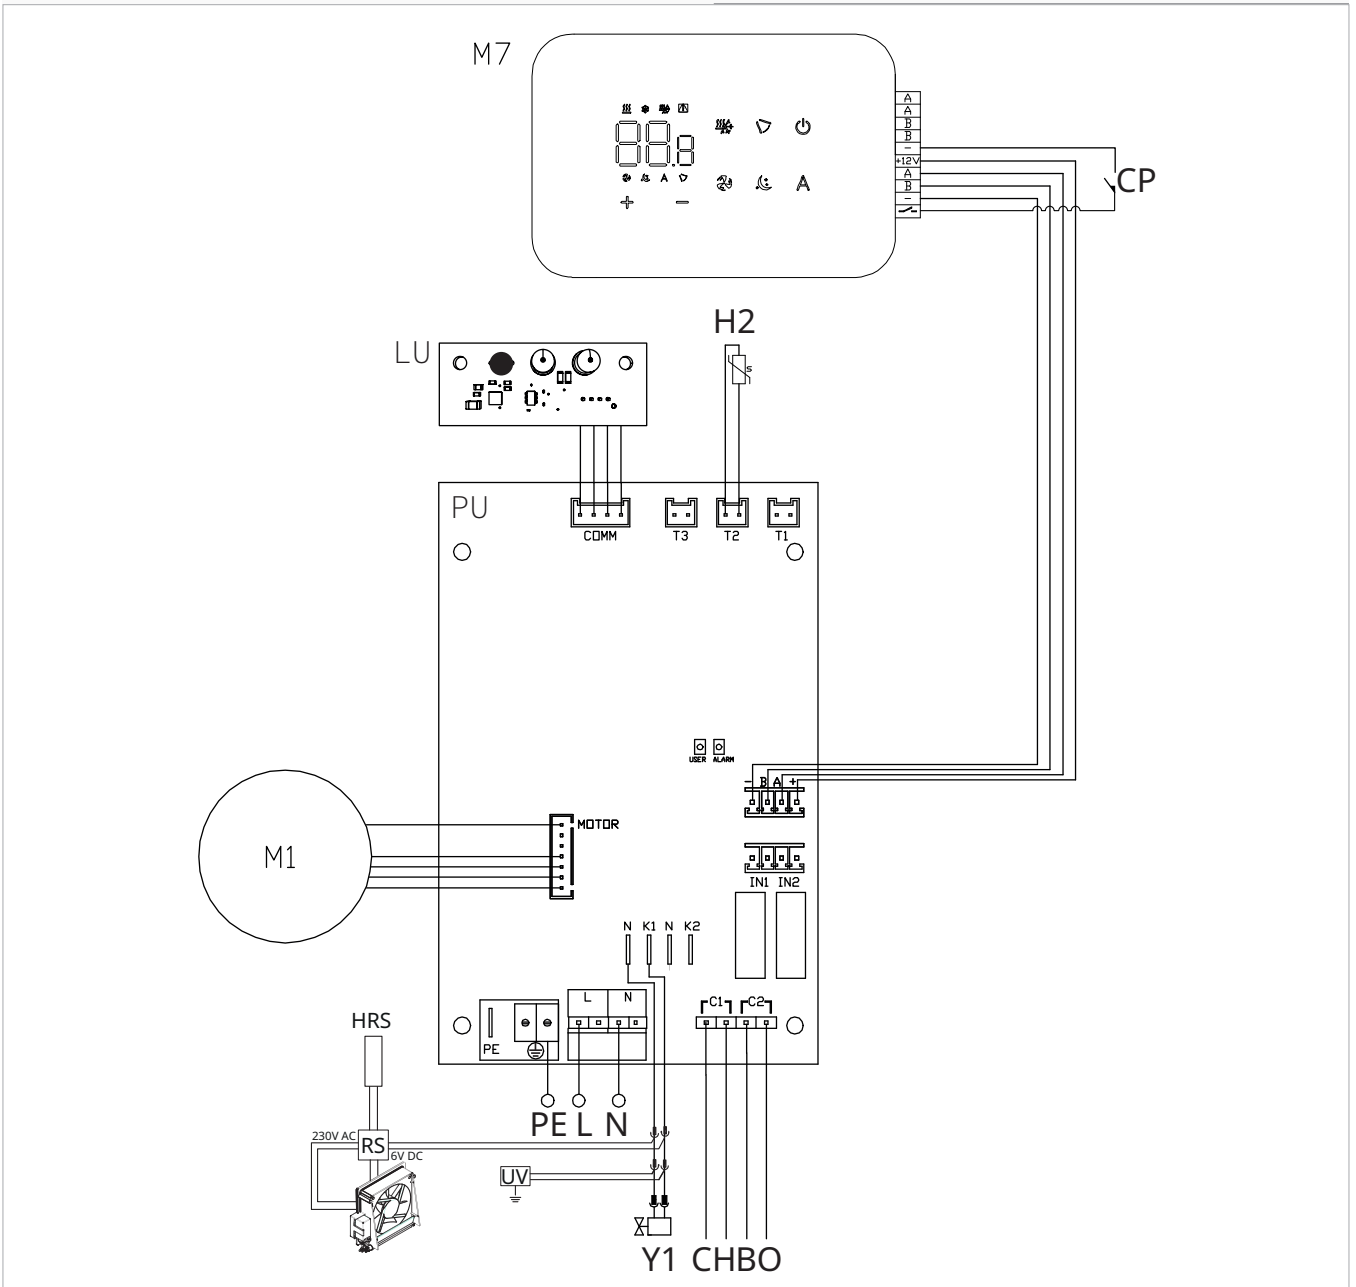


⚠ For models with hydraulic connections on the right hand side, please refer to "Models with right-hand hydraulic connections" [p. 20](#) to make the connections.

⚠ For radiant panel (RS) versions, please refer to the "Version configurations" section to make the connections.

6.4 Multiple connection diagram

- | | | | |
|----|--------------------------------------|----|--------------------------------------|
| 1. | M7 series wall control panel | 3. | PCB |
| 2. | Terminal block for device connection | 4. | Board for pairing control and device |

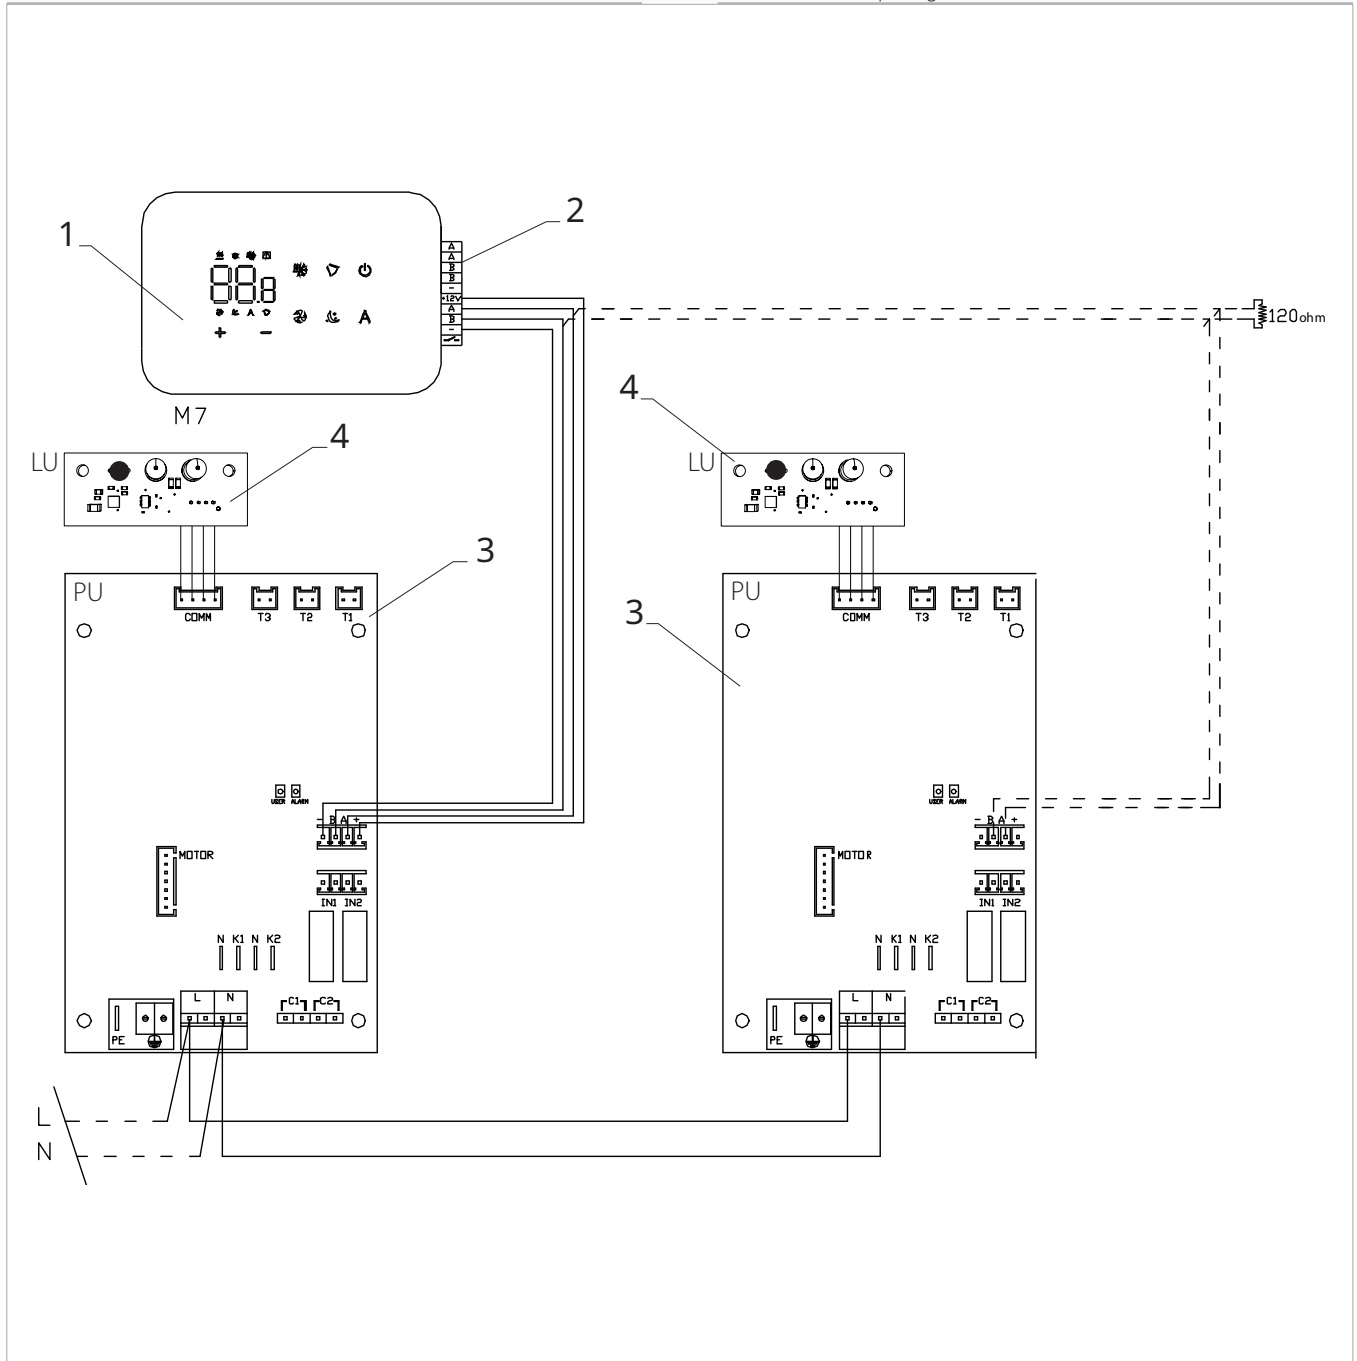


6.5 Connections

6.5.1 Preliminary warnings


- ⚠ The terminals for connecting the control panel and the presence contact CP are placed in a plastic bag and positioned inside the cover of the electrical box.

1. Terminal blocks

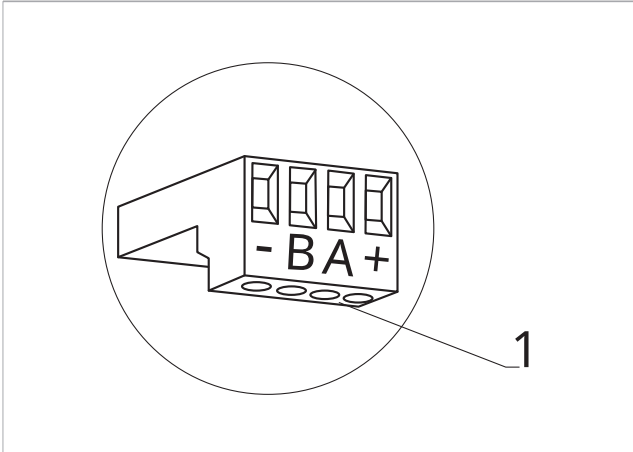

The terminals accept:

- rigid or flexible wires with a 0.2 to 1 mm² cross-section
- rigid or flexible wires with 0,5 mm² cross-section if two wires are connected to the same terminal block
- rigid or flexible wires with 0,75 mm² cross-section if the wires have wire end ferrules with a plastic collar

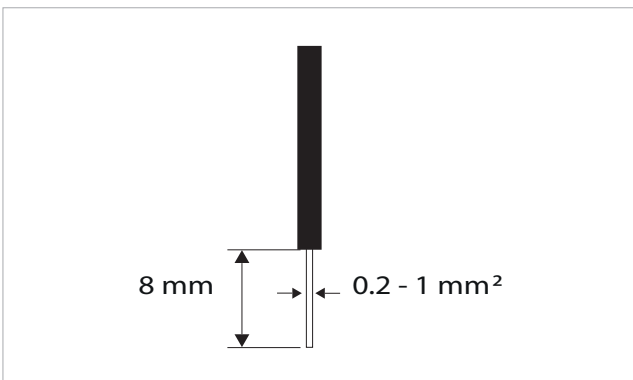

To connect the cables:


- strip 8 mm of the wire
- if the wire is rigid, you can insert it easily whereas
- if it is flexible, use appropriate crimp terminals
- push the wire completely in
- check the right fixing by pulling it gently

6.5.2 Control Panel


- ⚠ The control panel for wall control must be ordered separately.

Terminal block position:

1. Terminal block (Back view panel)

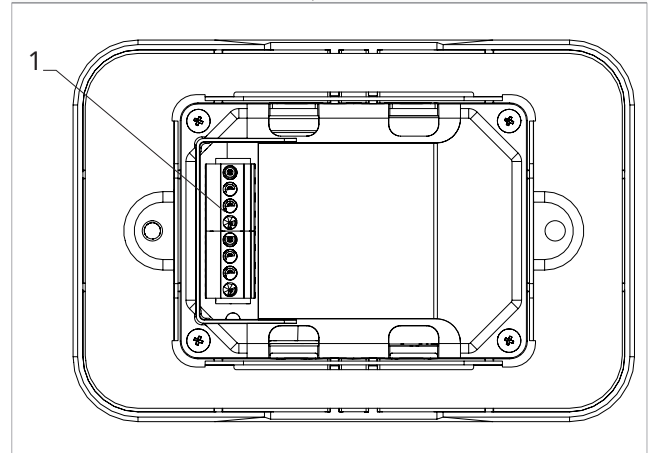

1. Terminal blocks

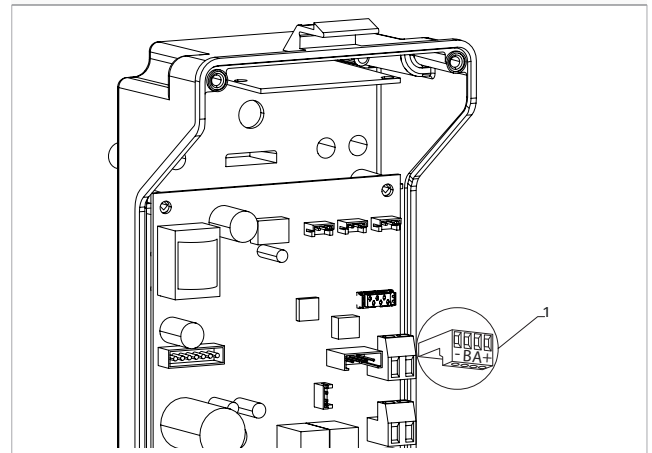

To connect the wall control panel to the board:

- connect the power supply cables to the + - terminals
- connect the ModBus serial connection cables to terminals A and B

6.5.3 Presence contact CP

Through this contact it is possible to connect an external device that inhibits the operation of the device, for example:

- opening window contact
- remote on/off
- infrared presence sensor
- enabling badge
- remote change of season

Function

The contact is normally open.

- when closing the CP contact, connected to a potential-free contact, the device switches to stand-by mode

CP appears on the display.

- At the touch of a button on the display the symbol ⚠ flashes.

- ⊖ It is forbidden to connect in parallel the CP input to one of another electronic board. Use separate contacts.

The CP presence contact can be configured for heating and cooling operation via the "To select digital input" [p. 27](#) settings menu item (digital input).

6.5.4 RS485 Serial Connection

The wall-mounted remote control can be connected through a RS485 serial line to one or more device, for a maximum of 16.

The devices must be equipped with an electronic board suitable for remote control.

For the connection:






- follow the indication on the connection diagram

- connect respecting the indication A and B
- ⚠ Use a bipolar shielded cable suitable for the RS485 serial connection with a minimum section of 0,35 mm².
- ⚠ Keeping the bipolar cable separate from power supply cables.
- ⚠ Chase out the wall in order to minimize the length of the leads.
- ⚠ Complete the line with the 120 Ω resistance.
- ⊖ It is forbidden make star connections.



6.6 Functions

6.6.1 Basic menu

To access the basic menu

- with the display off, hold down  for 10 seconds
The device turns on and  appears
- keep pressed until the indication  appears
- release the  key
The symbol  appears


To navigate in the menu

- use the icons  

To select a menu item and to confirm the changes made

- press the icon 
Confirming the change takes you to the next item.

To exit the menu

- press the icon  for 10 seconds
- or wait 30 seconds the automatic shutdown

⚠ After 30 seconds from the last action the control goes out and the settings is memorized.

Menu items

ot: AIR probe offset (air probe setting)

ur: Value read by the R.H. sensor

ut: Probe Offset PT4

uS: Humidity setpoint

ui: Humidity hysteresis

CF: Scale






ub: Buzzer volume

uu: Not used

uP: Not used

Set AIR probe offset






To set the air probe regulation

- select 
- press  to change settings
- increase or decrease the value with the icons  
- press  to confirm
*By default it is set to 0.
The setting range is from a minimum of -12.0 °C to a maximum of 12.0 °C.*

Set probe offset RH






⚠ Modify only after real deviations from an actual measurement with professional instrumentation have been established.

To set the RH probe regulation

- select 
- press  to change settings
- increase or decrease the value with the icons  
- press  to confirm






Set the humidity setpoint

To set the humidity setpoint

- select 
- press  to change settings
- increase or decrease the value with the icons  
- press  to confirm
The setting range is from 20.0% to 90.0%.

Setting the humidity hysteresis

To set the humidity hysteresis

- select 
- press  to change settings
- increase or decrease the value with the icons  
- press  to confirm
The setting range is from 1 (min) to 30 (max).

Scale

To change the temperature unit of measure

- select
 - press to change settings
 - select °C or °F
 - press to confirm
- By default the temperature unit of measure is °C.*

Adjusting the volume

To change the volume

- select
 - press to change settings
 - increase or decrease the value with the icons
 - press to confirm
- The volume setting range is from 00 (min) to 03 (max).*

The volume changes after confirm the modification.

6.6.2 Advanced Menu

To access the Setup menu, it is necessary to access the Basic menu. See section "Basic menu" p. 26.

The special functions menu can be accessed via the control panel.

To access the setup menu

- from the basic menu press
- Appears*
- press the key once
- Appears*
- press to confirm and log in
- The advanced menu is accessed.*

To navigate in the menu

- use the icons

To select a menu item and to confirm the changes made

- press for 2 seconds
- Confirming the change takes you to the next item.*

To exit the menu

- press for about 10 seconds
- Appears*
- press for about 10 seconds
- The display turns off.*
- or wait 30 seconds after the last action
- The display is switched off automatically.*

After 30 seconds from the last action the control goes out and the settings is memorized.

Menu items

Ad: Not used

Pr: Not used

of: Options for digital output

rH: Radiant heating options with R20

rC: Radiant cooling options with R20

UC: Not used

Ac: Not used

Ah: Not used

Ed: Not used

Fr: Not used

To select digital input

To change the digital input

- select
 - press to change settings
 - select CP for contact presence (default)
 - select CO to cooling open
 - select CC to cooling close
 - press to confirm
- By default digital input is set to CP.*

For return to the default settings, set the digital input to "CP".

By selecting one of the other inputs (CO,CC) the seasonality is locked. It is not possible to modify it through the key of the control.

Set radiant options in heating with R20

To change the rH function, it is necessary to have the accessory MZS - Single zone module for radiant system, code EG1028II.

To change the settings, please refer to the Instruction Sheet of the accessory MZS - Single zone module for radiant system, code EG1028II.

Set radiant options to cooling with R20

To change the rC function, it is necessary to have the accessory MZS - Single zone module for radiant system, code EG1028II.

To change the settings, please refer to the Instruction Sheet of the accessory MZS - Single zone module for radiant system, code EG1028II.


6.6.3 Pairing of control and unit

To pair the control with the unit

- with control switched on, at the same time press and for about 10 seconds
- In the display area, where the setpoint is indicated, appears the number of connected devices.*

The displayed value flashes.

1. Red LED
2. Green LED
3. Black button
4. Electrical box

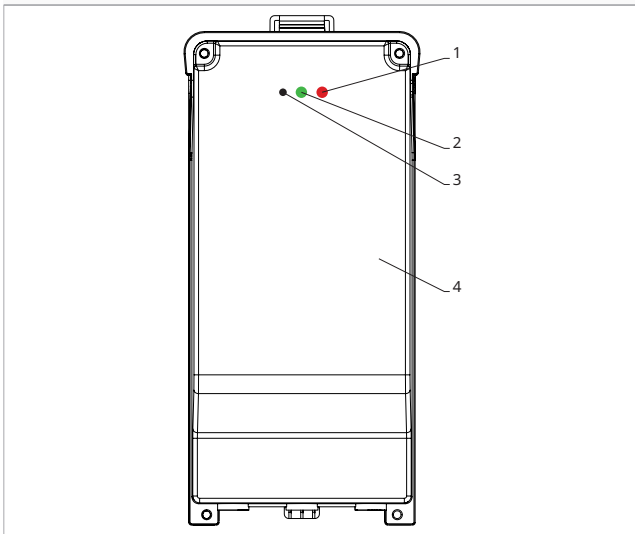

On the electrical box on the unit

- press the black button for 3 seconds
The green LED flashes.
The red LED is on.
- wait for the procedure to complete
The green LED stops flashing.

On the wall mounted control panel

- *Appear the number assigned to the fancoil.*
Then appears the number of connected devices.
- press to exit the menu

⚠ To reset the pairing settings, it is first necessary to access the basic menu. See section "Basic menu" p. 26.

To reset pairing settings

- access the basic menu
- press
- press
- *All the way to the menu.*
- press

To reset a single fancoil

- *Appears .*
- press
- *Appears .*
- press to log in
- use the icons to move inside the menu
The assignment numbers assigned to the fancoils appear.
- select the fancoil to be reset
- press to confirm
 appears, with an acoustic signal.
The device is removed.

To exit the setting

- press for 5 seconds
Exit the setting.
Back to menu 02.

To reset all fancoils

Appears .

- press until appears
Appears .
- press to confirm
- use the icons to move inside the menu
- select No to maintain all fancoils
- select Yes to reset the fancoils
- press to confirm

LED interface operation on the electrical box

If the device is being paired

The green LED flashes.

If the device is paired and functioning

The green LED is on.

If the device has not been paired and is not functional

The green LED is off.
The red LED is on.

If the device is in alarm status

The red LED flashes.

⚠ The red LED flashes according to the type of alarm. To check the alarm type, please refer to the following "Error signals" p. 28 section.


If communication with the board is missing

The green and red LEDs will flash once every second.

6.6.4 Error signals

The PCB has a status LED.

1. LED

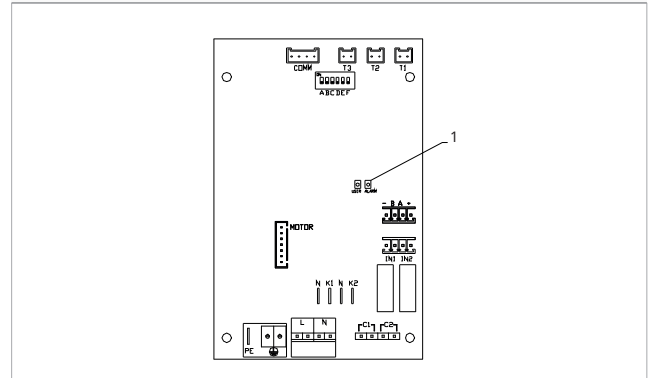

⚠ The LED on the cover of the electrical box performs the same functions as the LED on the machine board.

⚠ The flashing LED indicates errors.

⚠ With the LED on and no indication on the display, it is indicated that there are no errors.

LED signals

- Led flashing
Errors to be shown on the display.
- LED off
Remote control switched off.
- LED continuous flashing with pause between flashes
Unsuitable water temperature alarm.
- LED on
Wall control on and no alarm present.

- LED 2 flashes / pause
Internal fan motor alarm faulty or disconnected.
- LED 3 flashes / pause
Alarm for water temperature probe H2/T2 disconnected or faulty.
- LED 6 flashes / pause
Communication error alarm with wall control panel.





6.6.5 Alarm display on wall control panel

⚠ In the event of an alarm, the device still maintains active functions.

⚠ The symbol  is displayed on the wall control panel to indicate alarms.

⚠ **To access the Setup menu, it is necessary to access the Basic menu. See section "Basic menu" p. 26.**

To visualise errors on the wall control panel

- access the basic menu
- press 
Appears .
- press 
Appears .
Then the number assigned to the fancoil appears and then the error is displayed.

Displayed alarms


- E2 Faulty internal fan motor or disconnected
None of the modes can be activated.
- E3 Water temperature probe H2/T2 disconnected or failure
None of the modes can be activated.
- E5 H4/T3 heating water probe disconnected or faulty
None of the modes can be activated.
- E6 Incorrect water temperature with automatic season function setting
The fancoil is performing heating and cooling functions incorrectly. None of the unit's functions can be activated.
- E8 Communication error
Communication error between the wall control panel and the fancoil.
- h2o Incorrect water temperature
*In heating mode, the water temperature is below 30 °C.
In cooling mode, the water temperature is above 20 °C.*

⚠ Error E8 is displayed without the error display procedure on the wall control panel.

M7 SERIES CONTROL PART NO. EFB749

7.1 Interface

- 1. Display area
- 2. Keys area

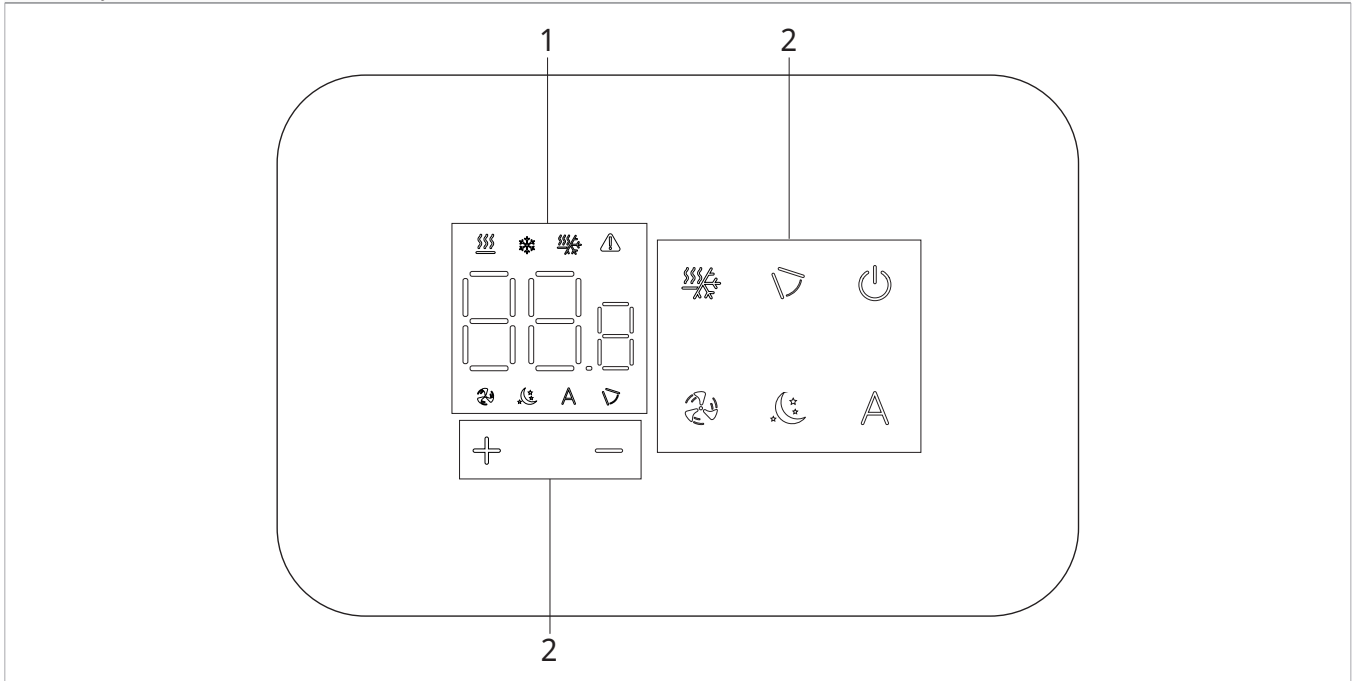

7.2 Installation


7.2.1 Description

the wall-mounted remote control is an electronic LED thermostat with a touch interface, with the possibility of control over multiple appliances equipped with the same electronic board. It is equipped with a temperature and humidity probe.

- ⚠ The control can control up to a maximum of 16 units.
- ⚠ For wall control code EFB749, the INNOVA app is available.

7.2.2 Mounting

- ⚠ The control panel for wall control is to be installed inside a 503 electrical box.
- ⚠ A wall must be prepared to accommodate the 503 electrical box before installing the wall control.

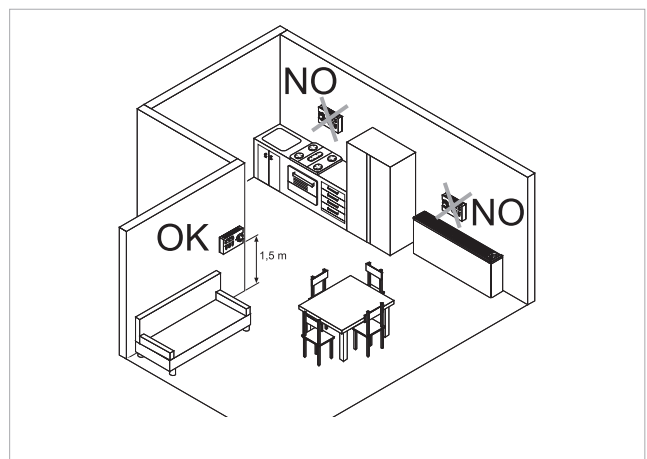


The wall-mounted remote control must be installed:

- on internal walls
- at a height of about 1,5 m from the floor
- away from doors or windows
- away from heat sources (heaters, convectors, stoves, direct sunlight)

- ⚠ The wall control is provided inside the package already assembled.

1. Base of control
2. Wall-mounted control panel

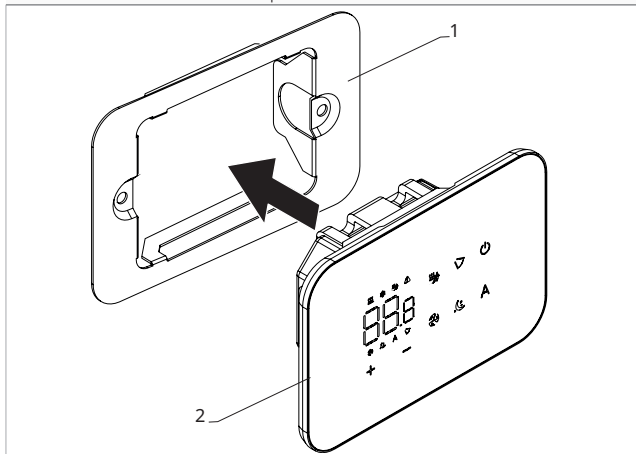


- Close the control panel

⚠ Pay attention not to crush the conductors when you close the control.

Before wall installation:

- separate the control base from the control panel

1. Fixing screws
2. Base of control
3. Holes for fixing to electrical box
4. Electric box 503

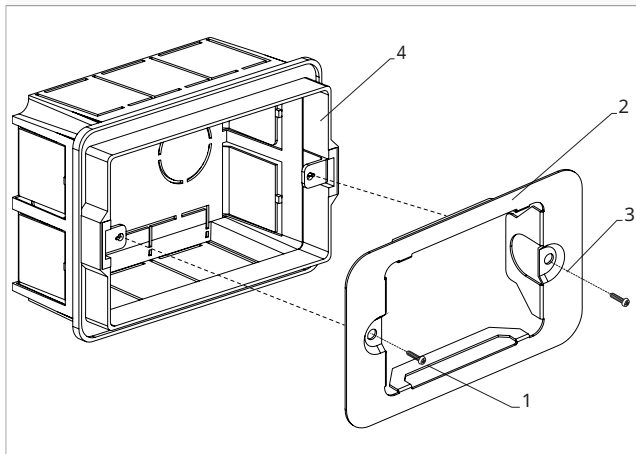


For wall mounting of the control panel:

- fix the control base to the electrical box 503 with screws
- connect the electrics

⚠ Before making the connections, please verify that the control terminal block is on the right-hand side.


1. Electric box 503
2. Base of control
3. Wall-mounted control panel

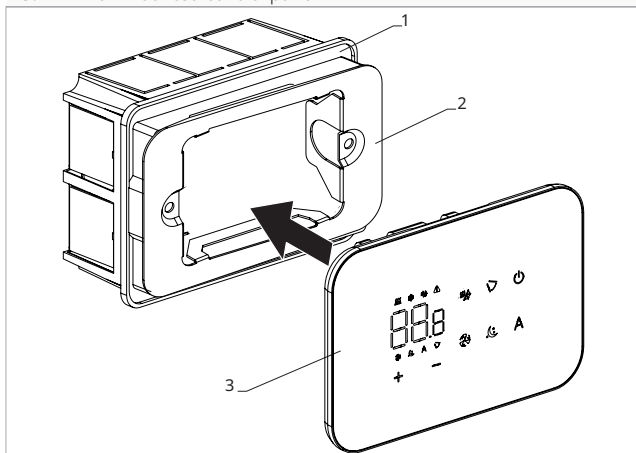

7.3 Single connection diagram

M1	Fan motor DC Inverter
PE	Earth connection
L-N	Power supply connection 230 V / 50 Hz / 1 A
Y1	Water electrovalve (voltage output 230 V / 50 Hz / 1 A)
CH/C1	Cooling request contact (for example chiller or reversible heat pump). Activated in parallel with the solenoid valve output (Y1) with 1 minute delay when the fancoil is in cooling mode and is on call (potential-free contact max. 1 A).
BO/C2	Heating request contact (for example boiler or heat pump). Activated in parallel with the output of the solenoid valve (Y1)

	with 1 minute delay when the fancoil is in heating mode and is on call (potential-free contact max. 1 A).
CP	Presence contact (normally open)
-BA+	Serial connection for wall-mounted remote control (respect polarisation AB)
IN1	Potential-free input 1(not active)
H2/T2	2-pipe water temperature probe
RS	RS version wiring
HRS	water probe RS version (10 kΩ)
LU	Electronic board for pairing control and device
PU	Electronic board on the unit

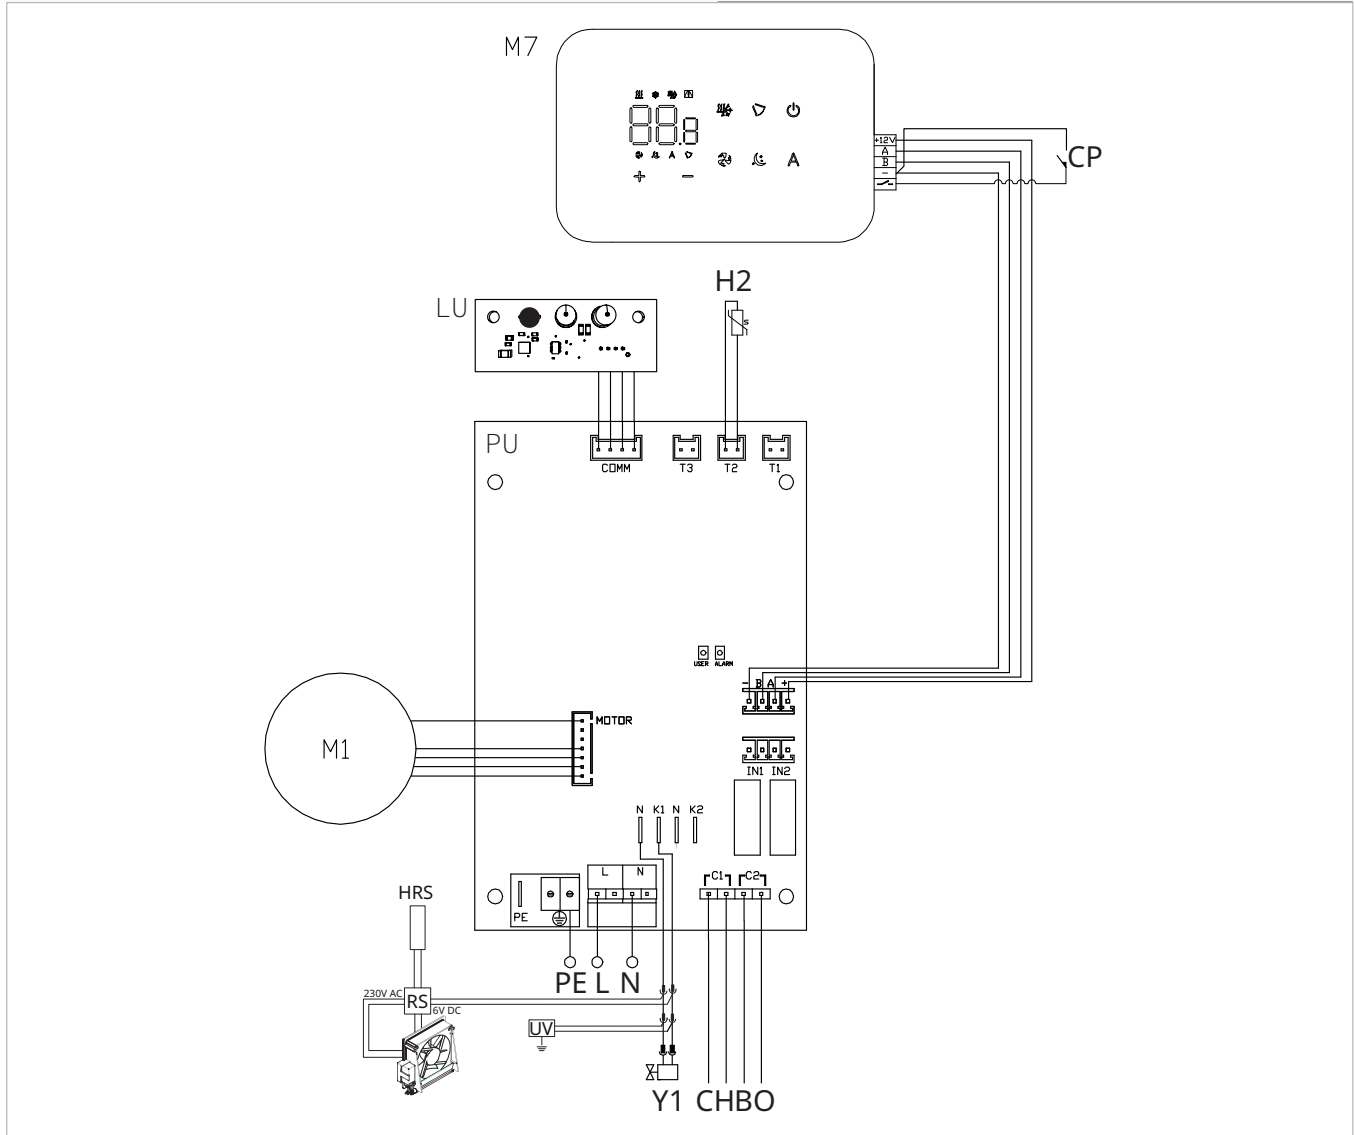


- ⚠ For models with hydraulic connections on the right hand side, please refer to "Models with right-hand hydraulic connections" [p. 20](#) to make the connections.
- ⚠ For radiant panel (RS) versions, please refer to the "Version configurations" section to make the connections.
- ⚠ For wall control code EFB749, the INNOVA app is available.

7.4 Multiple connection diagram

- 1. M7 series wall control panel
- 2. Terminal block for device connection

- 3. PCB
- 4. Board for pairing control and device

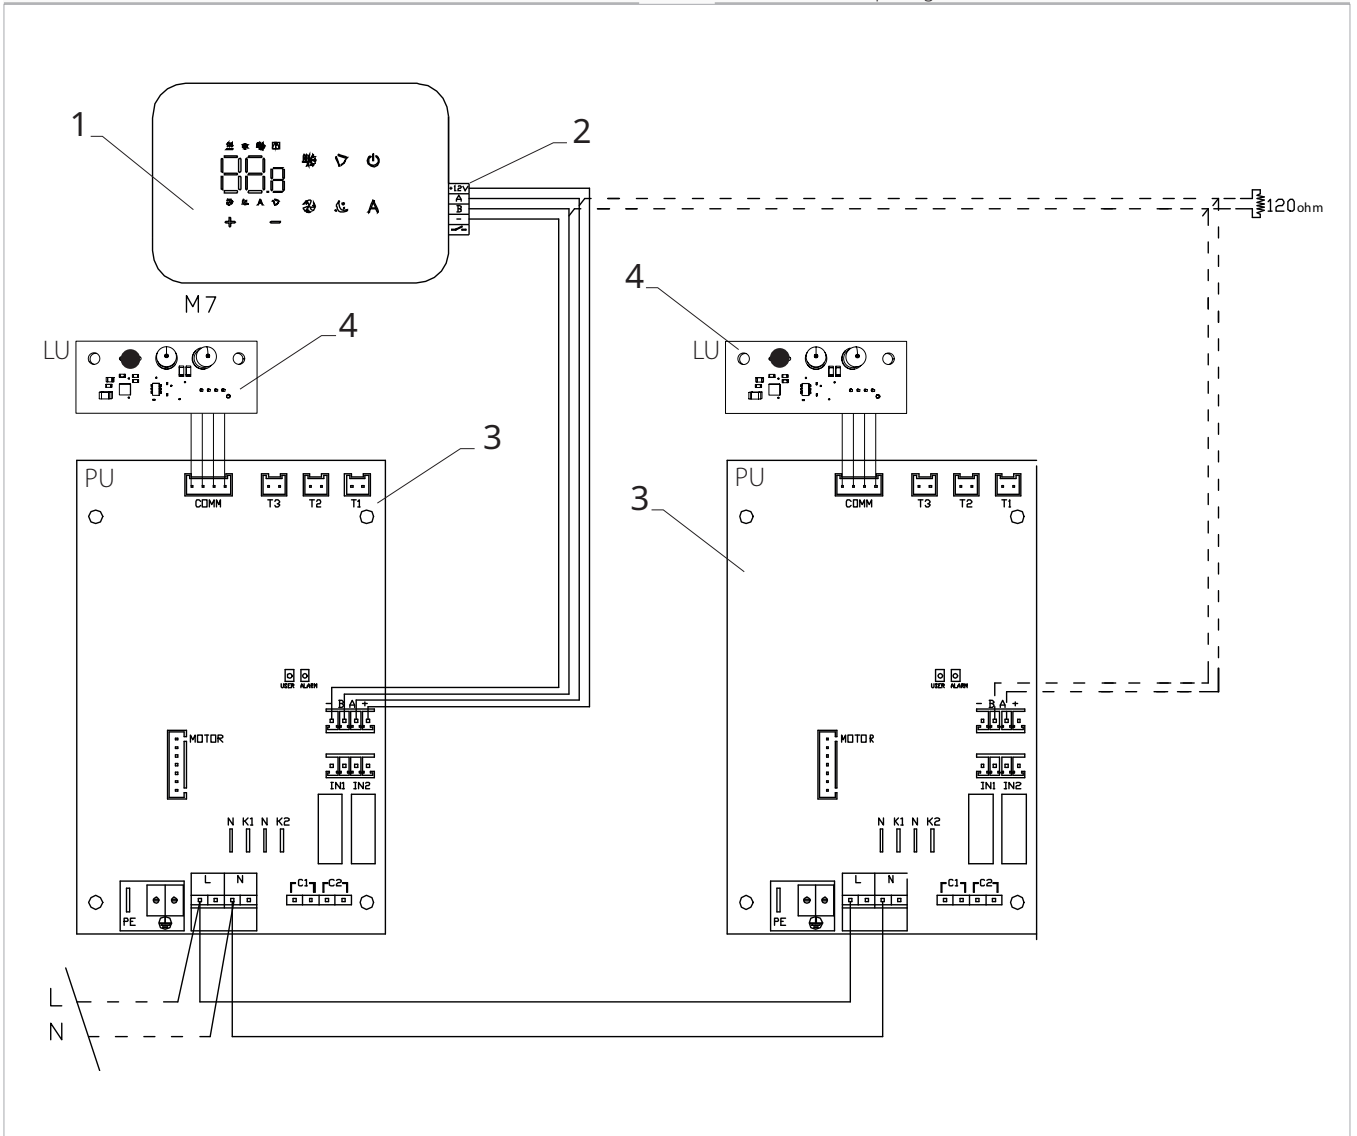


7.5 Connections

7.5.1 Preliminary warnings


⚠ The terminals for connecting the control panel and the presence contact CP are placed in a plastic bag and positioned inside the cover of the electrical box.

1. Terminal blocks

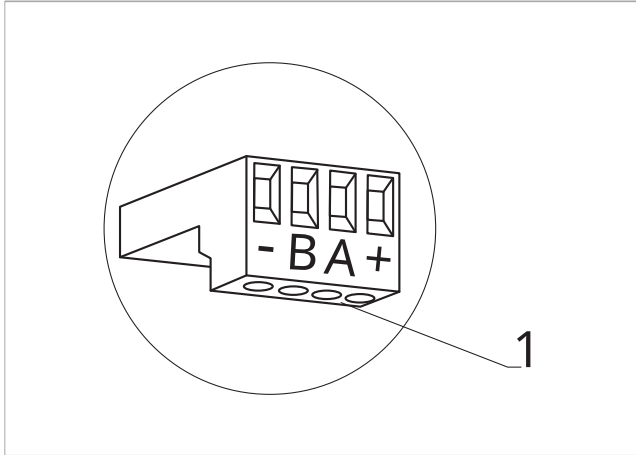

The terminals accept:

- rigid or flexible wires with a 0.2 to 1 mm² cross-section
- rigid or flexible wires with 0,5 mm² cross-section if two wires are connected to the same terminal block
- rigid or flexible wires with 0,75 mm² cross-section if the wires have wire end ferrules with a plastic collar

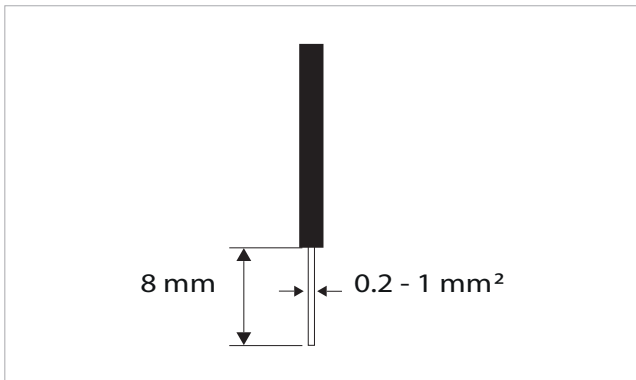

To connect the cables:


- strip 8 mm of the wire
- if the wire is rigid, you can insert it easily whereas
- if it is flexible, use appropriate crimp terminals
- push the wire completely in
- check the right fixing by pulling it gently

7.5.2 Control Panel


⚠ The control panel for wall control must be ordered separately.

Terminal block position:

1. Terminal block (Back view panel)

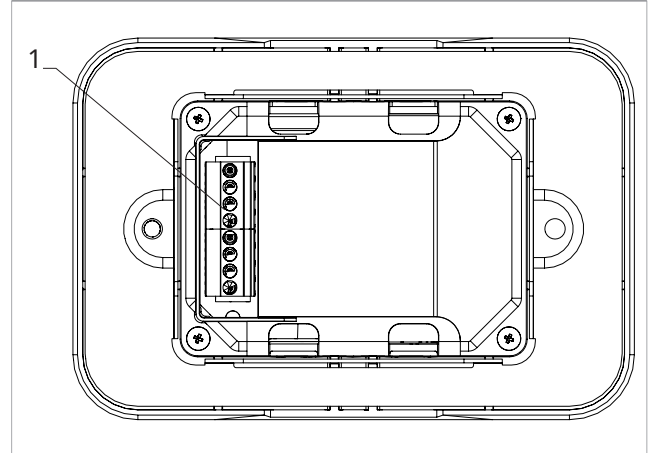

1. Terminal blocks

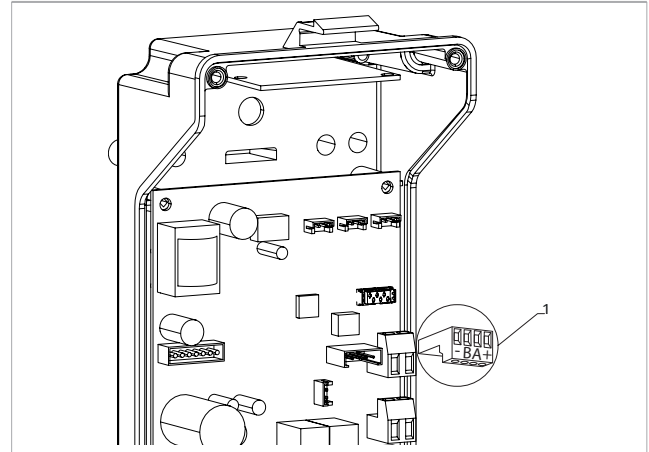

To connect the wall control panel to the board:

- connect the power supply cables to the + - terminals
- connect the ModBus serial connection cables to terminals A and B

7.5.3 Presence contact CP

Trough this contact it is possible connect an external device that inhibits the operation of the device, for example:

- opening window contact
- remote on/off
- infrared presence sensor
- enabling badge
- remote change of season

Function

The contact is normally open.

- when closing the CP contact, connected to a potential-free contact, the device switches to stand-by mode

CP appears on the display.

- At the touch of a button on the display the symbol ⚠ flashes.

⊖ It is forbidden connect in parallel the CP input to one of another electronic board. Use separate contacts.

The CP presence contact can be configured for heating and cooling operation via the "To select digital input" [p. 27](#) settings menu item (digital input).

7.5.4 RS485 Serial Connection

The wall-mounted remote control can be connected through a RS485 serial line to one or more device, for a maximum of 16.

The devices must be equipped with an electronic board suitable for remote control.

For the connection:

- follow the indication on the connection diagram


- connect respecting the indication A and B

- ⚠ Use a bipolar shielded cable suitable for the RS485 serial connection with a minimum section of 0,35 mm².
- ⚠ Keeping the bipolar cable separate from power supply cables.
- ⚠ Chase out the wall in order to minimize the length of the leads.
- ⚠ Complete the line with the 120 Ω resistance.
- ⊖ It is forbidden make star connections.



7.6 Functions


7.6.1 Basic menu

To access the basic menu



- with the display off, hold down  for 10 seconds

The device turns on and  appears


- keep pressed until the indication  appears
- release the  key

The symbol  appears


To navigate in the menu

- use the icons  

To select a menu item and to confirm the changes made

- press the icon 
- Confirming the change takes you to the next item.*

To exit the menu

- press the icon  for 10 seconds
- or wait 30 seconds the automatic shutdown

- ⚠ After 30 seconds from the last action the control goes out and the settings is memorized.

Menu items

ot: AIR probe offset (air probe setting)

ur: Value read by the R.H. sensor

ut: Probe Offset PT4

uS: Humidity setpoint

ui: Humidity hysteresis

CF: Scale





ub: Buzzer volume

uu: Wi-Fi reset

uP: Wi-Fi pairing

Set AIR probe offset

To set the air probe regulation

- select 
- press  to change settings
- increase or decrease the value with the icons  

- press  to confirm






By default it is set to 0.

The setting range is from a minimum of -12.0 °C to a maximum of 12.0 °C.

Set probe offset RH






⚠ Modify only after real deviations from an actual measurement with professional instrumentation have been established.

To set the RH probe regulation

- select 
- press  to change settings
- increase or decrease the value with the icons  
- press  to confirm






Set the humidity setpoint

To set the humidity setpoint

- select 
- press  to change settings
- increase or decrease the value with the icons  
- press  to confirm
The setting range is from 20.0% to 90.0%.




Setting the humidity hysteresis

To set the humidity hysteresis

- select 
- press  to change settings
- increase or decrease the value with the icons  
- press  to confirm
The setting range is from 1 (min) to 30 (max).

Scale

To change the temperature unit of measure






- select 
- press  to change settings
- select °C o °F
- press  to confirm
By default the temperature unit of measure is °C.

7.6.2 Advanced Menu


⚠ **To access the Setup menu, it is necessary to access the Basic menu. See section "Basic menu" p. 26.**

The special functions menu can be accessed via the control panel.


To access the setup menu

- from the basic menu press 
- Appears *
- press the  key once
Appears 
- press  to confirm and log in
The advanced menu is accessed.

To navigate in the menu






- use the icons  

To select a menu item and to confirm the changes made

- press  for 2 seconds
Confirming the change takes you to the next item.

Adjusting the volume






To change the volume

- select 
- press  to change settings
- increase or decrease the value with the icons  
- press  to confirm
The volume setting range is from 00 (min) to 03 (max).

⚠ The volume changes after confirm the modification.






Wi-Fi reset

To reset the Wi-Fi credentials and return the device to its original configuration

- select uu
- press  to change settings
- use the   icons in sequence
Appear no.
- press 
- Cr appears to reset Wi-Fi credentials.*
- press  to confirm
Credentials have been reset.




Activate Wi-Fi

To activate Wi-Fi

- select up
- press  to change settings
- use the   icons in sequence
Appear no.
- press 
- St appears to enable Wi-Fi pairing.*
- press  to confirm

⚠ The device remains visible on the INNOVA App for the first 15 minutes after the device is switched on.

To exit the menu

- press  for about 10 seconds
Appears 
- press  for about 10 seconds
The display turns off.
- or wait 30 seconds after the last action
The display is switched off automatically.

⚠ After 30 seconds from the last action the control goes out and the settings is memorized.

Menu items

Ad: Not used

Pr: Not used

of: Options for digital output

rH: Radiant heating options with R20

rC: Radiant cooling options with R20

UC: Not used

Ac: Not used

Ah: Not used

Ed: Not used

Fr: Not used

To select digital input

To change the digital input

- select
 - press to change settings
 - select CP for contact presence (default)
 - select CO to cooling open
 - select CC to cooling close
 - press to confirm
- By default digital input is set to CP.*


For return to the default settings, set the digital input to "CP".

7.6.3 Pairing of control and unit

To pair the control with the unit

- with control switched on, at the same time press and for about 10 seconds
- In the display area, where the setpoint is indicated, appears the number of connected devices. The displayed value flashes.*

- | | |
|----|----------------|
| 1. | Red LED |
| 2. | Green LED |
| 3. | Black button |
| 4. | Electrical box |

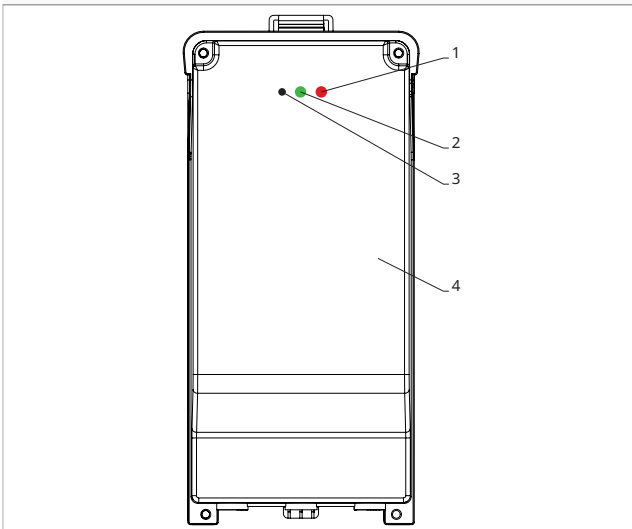

On the electrical box on the unit

- press the black button for 3 seconds
- The green LED flashes.*
- The red LED is on.*
- wait for the procedure to complete
- The green LED stops flashing.*

On the wall mounted control panel

Appear the number assigned to the fancoil.
Then appears the number of connected devices.

By selecting one of the other inputs (CO,CC) the seasonality is locked. It is not possible to modify it through the key of the control.

Set radiant options in heating with R20

To change the rH function, it is necessary to have the accessory MZS - Single zone module for radiant system, code EG1028II.

To change the settings, please refer to the Instruction Sheet of the accessory MZS - Single zone module for radiant system, code EG1028II.

Set radiant options to cooling with R20

To change the rC function, it is necessary to have the accessory MZS - Single zone module for radiant system, code EG1028II.

To change the settings, please refer to the Instruction Sheet of the accessory MZS - Single zone module for radiant system, code EG1028II.

- press to exit the menu

To reset the pairing settings, it is first necessary to access the basic menu. See section "Basic menu" p. 26.

To reset pairing settings

- access the basic menu
- press
- press
- All the way to the menu.*
- press

To reset a single fancoil

- Appears*
- press

Appears

 - press to log in
 - use the icons to move inside the menu
 - The assignment numbers assigned to the fancoils appear.*
 - select the fancoil to be reset
 - press to confirm
 - appears, with an acoustic signal.*
 - The device is removed.*




To exit the setting

- press for 5 seconds
- Exit the setting.*
- Back to menu 02.*

To reset all fancoils

- Appears*
- press until

Appears

- press  to confirm
- use the  icons to move inside the menu
- select No to maintain all fancoils
- select Yes to reset the fancoils
- press  to confirm

LED interface operation on the electrical box

If the device is being paired

The green LED flashes.

If the device is paired and functioning


The green LED is on.

If the device has not been paired and is not functional

*The green LED is off.
The red LED is on.*

If the device is in alarm status

The red LED flashes.

 The red LED flashes according to the type of alarm. To check the alarm type, please refer to the following "Error signals" [p. 28](#) section.


If communication with the board is missing




The green and red LEDs will flash once every second.

7.6.4 Error signals

The PCB has a status LED.

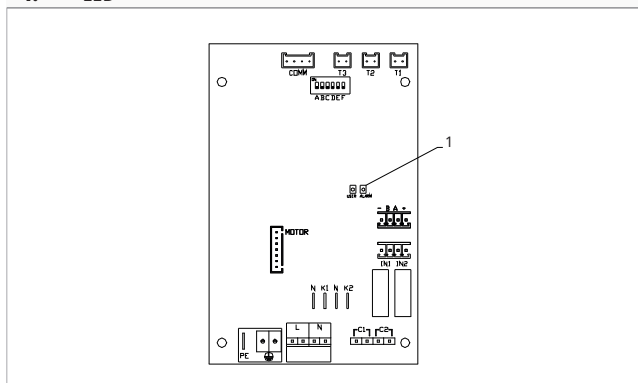1. LED




-  The LED on the cover of the electrical box performs the same functions as the LED on the machine board.
-  The flashing LED indicates errors.
-  With the LED on and no indication on the display, it is indicated that there are no errors.



LED signals

- Led flashing
Errors to be shown on the display.
- LED off
Remote control switched off.
- LED continuous flashing with pause between flashes
Unsuitable water temperature alarm.
- LED on
Wall control on and no alarm present.
- LED 2 flashes / pause
Internal fan motor alarm faulty or disconnected.

- LED 3 flashes / pause
Alarm for water temperature probe H2/T2 disconnected or faulty.
- LED 6 flashes / pause
Communication error alarm with wall control panel.





7.6.5 Alarm display on wall control panel

 In the event of an alarm, the device still maintains active functions.

 The symbol  is displayed on the wall control panel to indicate alarms.

 **To access the Setup menu, it is necessary to access the Basic menu. See section "Basic menu" [p. 26](#).**

To visualise errors on the wall control panel

- access the basic menu
- press 
Appears .
- press 
Appears .
Then the number assigned to the fancoil appears and then the error is displayed.

Displayed alarms


- E2 Faulty internal fan motor or disconnected
None of the modes can be activated.
- E3 Water temperature probe H2/T2 disconnected or failure
None of the modes can be activated.
- E5 H4/T3 heating water probe disconnected or faulty
None of the modes can be activated.
- E6 Incorrect water temperature with automatic season function setting
The fancoil is performing heating and cooling functions incorrectly. None of the unit's functions can be activated.
- E8 Communication error
Communication error between the wall control panel and the fancoil.
- h2o Incorrect water temperature
*In heating mode, the water temperature is below 30 °C.
In cooling mode, the water temperature is above 20 °C.*

 Error E8 is displayed without the error display procedure on the wall control panel.

M7 SERIES CONTROL CODE EGB749

8.1 Interface

1. Display area
2. Keys area

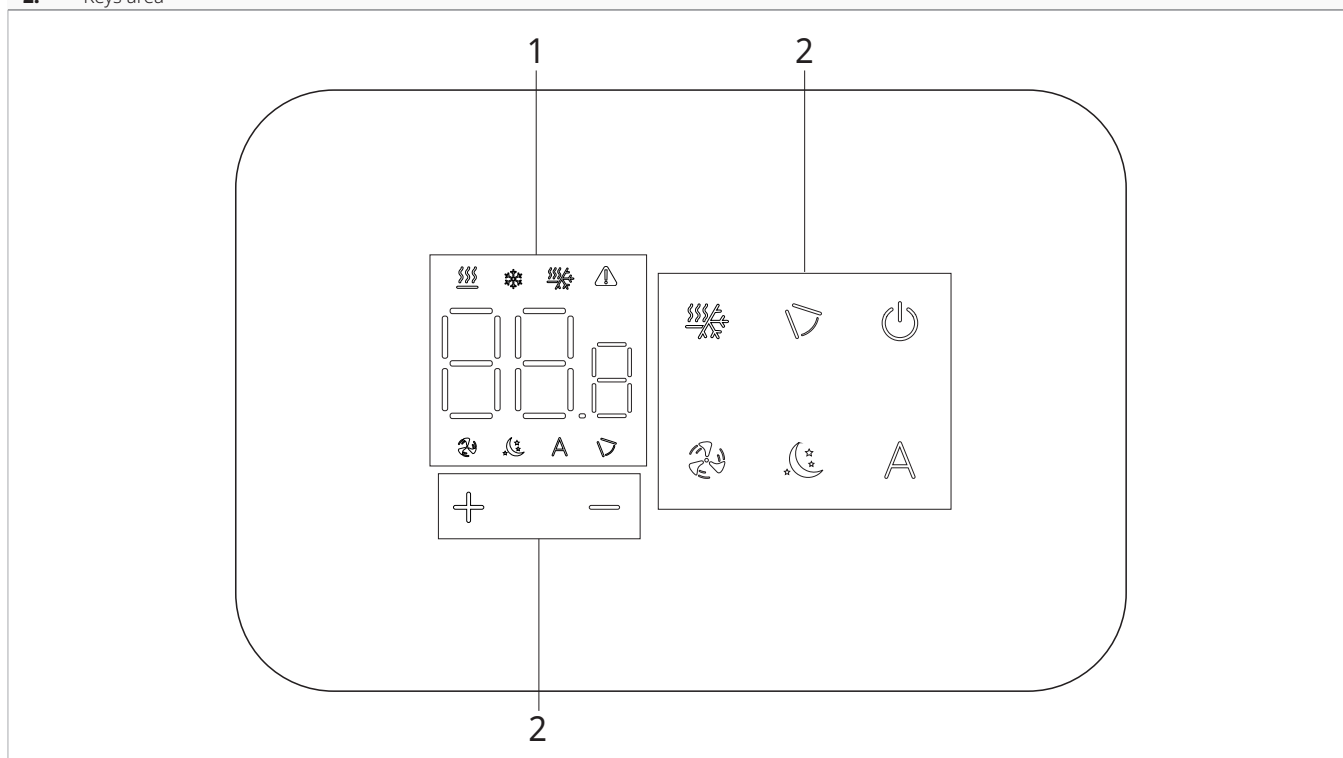

8.2 Installation


8.2.1 Description

the wall-mounted remote control is an electronic LED thermostat with a touch interface, with the possibility of control over multiple appliances equipped with the same electronic board. It is equipped with a temperature and humidity probe.

- ⚠ The control can control up to a maximum of 16 units.

8.2.2 Mounting

- ⚠ The control panel for wall control is to be installed inside a 503 electrical box.
- ⚠ A wall must be prepared to accommodate the 503 electrical box before installing the wall control.

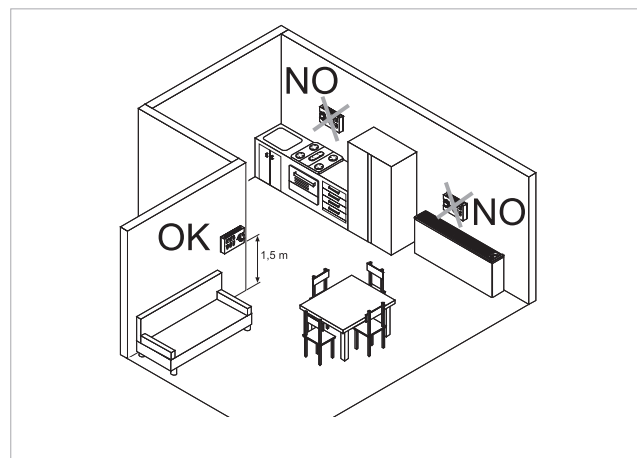


The wall-mounted remote control must be installed:

- on internal walls
- at a height of about 1,5 m from the floor
- away from doors or windows
- away from heat sources (heaters, convectors, stoves, direct sunlight)

⚠ The wall control is provided inside the package already assembled.


- 1. Base of control
- 2. Wall-mounted control panel

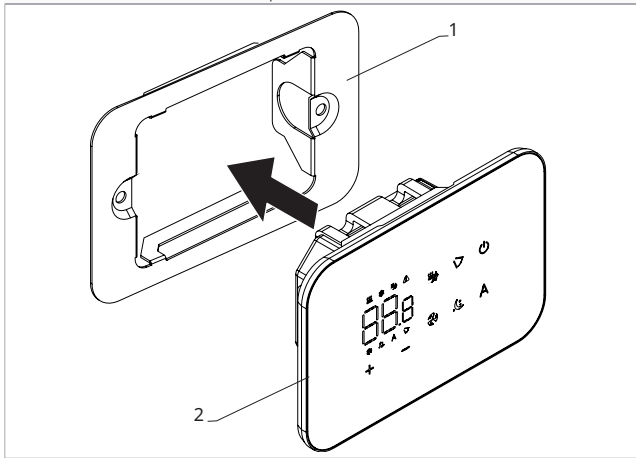

Before wall installation:

- separate the base of the control consisting of a plate from the control panel

- 1. Fixing screws
- 2. Base of control
- 3. Holes for fixing to electrical box
- 4. Electric box 503

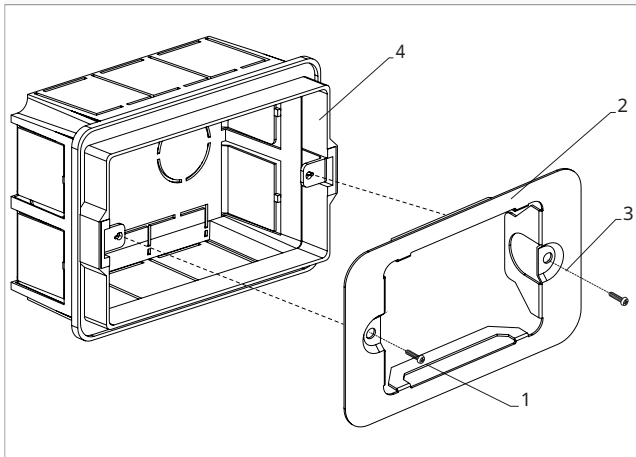


For wall mounting of the control panel:

- fix the control base to the electrical box 503 with screws
- connect the electrics

⚠ Before making the connections, please verify that the control terminal block is on the right-hand side.

- 1. Electric box 503
- 2. Base of control
- 3. Wall-mounted control panel

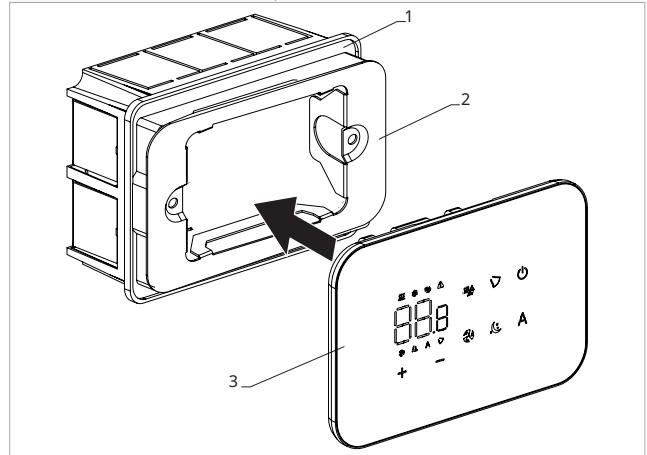

- Close the control panel


⚠ Pay attention not to crush the conductors when you close the control.

8.3 Single connection diagram

M1	Fan motor DC Inverter
PE	Earth connection
L-N	Power supply connection 230 V / 50 Hz / 1 A
Y1	Water electrovalve (voltage output 230 V / 50 Hz / 1 A)
CH/C1	Cooling request contact (for exemple chiller or reversible heat pump). Activated in parallel with the solenoid valve output (Y1) with 1 minute delay when the fancoil is in cooling mode and is on call (potential-free contact max. 1 A).
BO/C2	Heating request contact (for example boiler or heat pump). Activated in parallel with the output of the solenoid valve (Y1)

with 1 minute delay when the fancoil is in heating mode and is on call (potential-free contact max. 1 A).

CP	Presence contact (normally open)
IN1	Potential-free input 1(not active)
H2/T2	2-pipe water temperature probe
RS	RS version wiring
HRS	water probe RS version (10 k Ω)
PU	Electronic board on the unit
BT	Bluetooth communication card
LU	Electronic board for pairing control and device

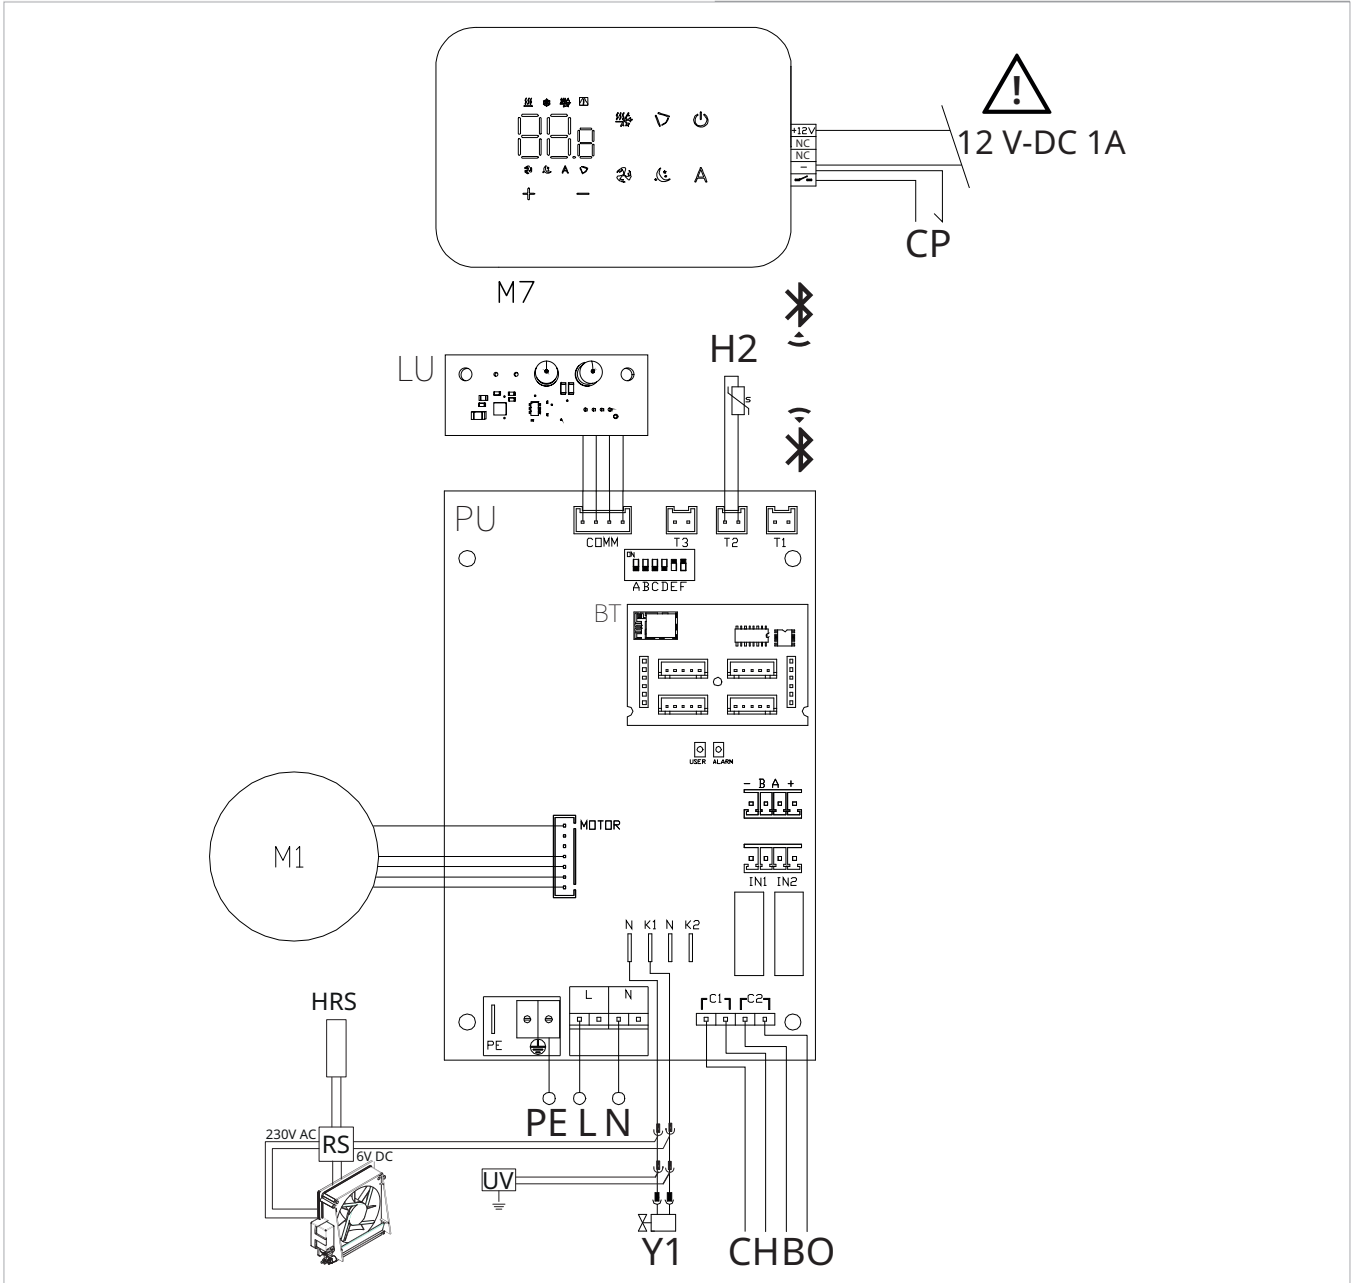


⚠ It is possible to power the control unit either via a separate 12 V-DC power supply (not supplied) or by connection to the - + contacts on the PU board.

⚠ For models with hydraulic connections on the right hand side, please refer to "Models with right-hand hydraulic connections" to make the connections.

⚠ For radiant panel (RS) versions, please refer to the "Version configurations" section to make the connections.

8.4 Multiple connection diagram

- | | | | |
|----|--------------------------------------|----|--------------------------------------|
| 1. | M7 series wall control panel | 3. | PCB |
| 2. | Terminal block for device connection | 4. | Board for pairing control and device |

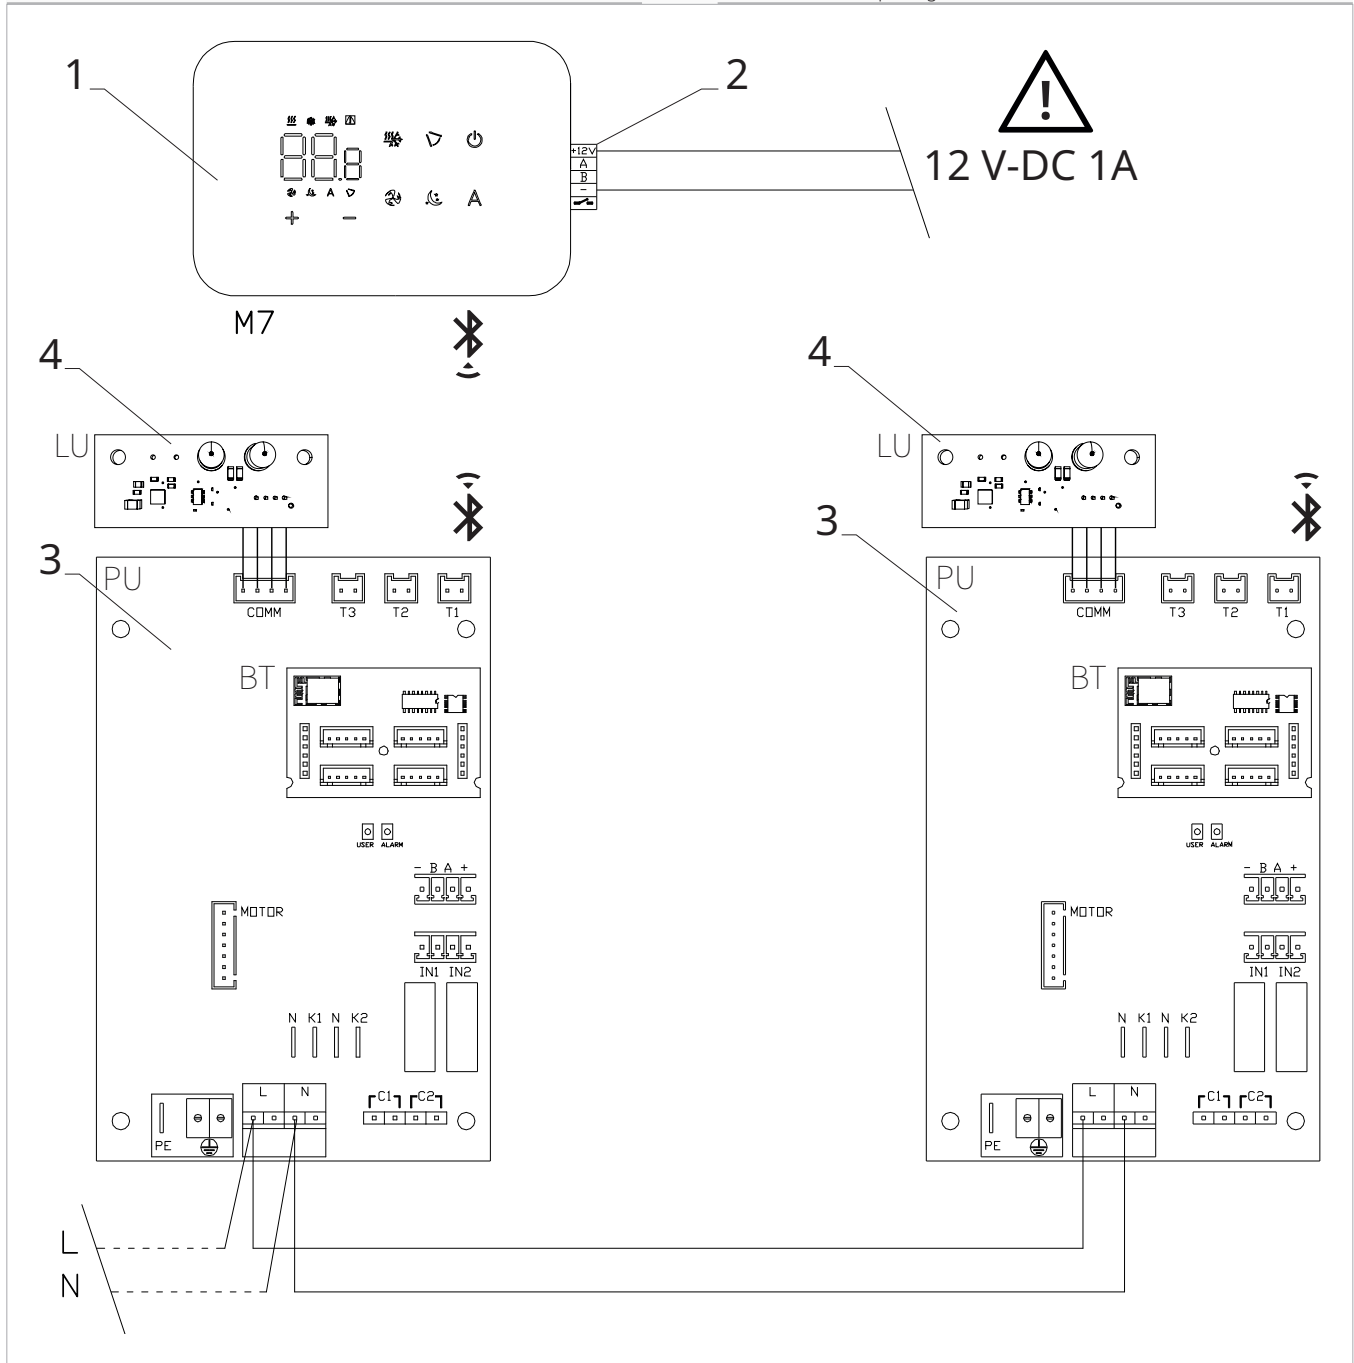


⚠ It is possible to power the control unit either via a separate 12 V-DC power supply (not supplied) or by connection to the - + contacts on the PU board.

8.5 Connections

8.5.1 Preliminary warnings


- ⚠ The terminals for connecting the control panel and the presence contact CP are placed in a plastic bag and positioned inside the cover of the electrical box.

1. Terminal blocks

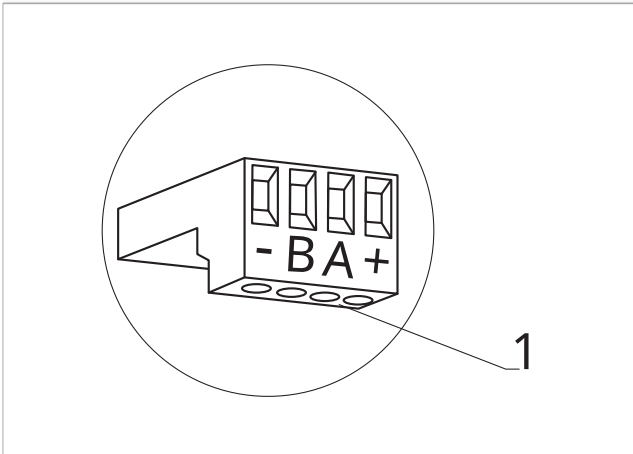

The terminals accept:

- rigid or flexible wires with a 0.2 to 1 mm² cross-section
- rigid or flexible wires with 0,5 mm² cross-section if two wires are connected to the same terminal block
- rigid or flexible wires with 0,75 mm² cross-section if the wires have wire end ferrules with a plastic collar

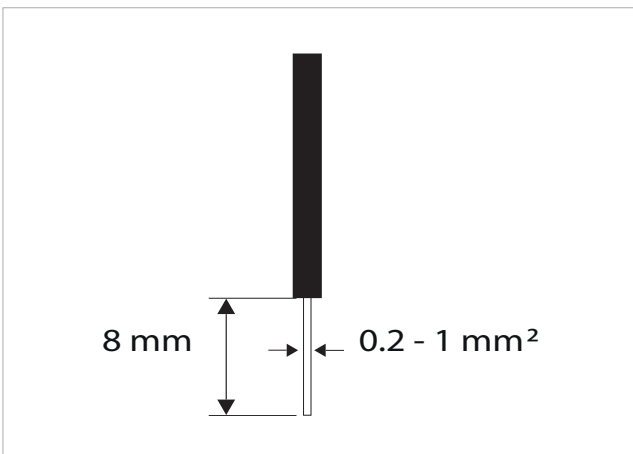

To connect the cables:


- strip the wire
- if the wire is rigid, you can insert it easily whereas
- if it is flexible, use appropriate crimp terminals
- push the wire completely in
- check the right fixing by pulling it gently

8.5.2 Control Panel


- ⚠ The control panel for wall control must be ordered separately.

Terminal block position:

1. Terminal block (Back view panel)

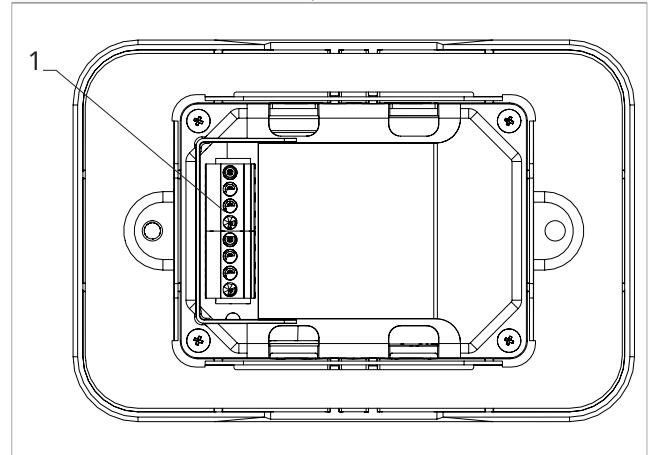

1. Terminal blocks

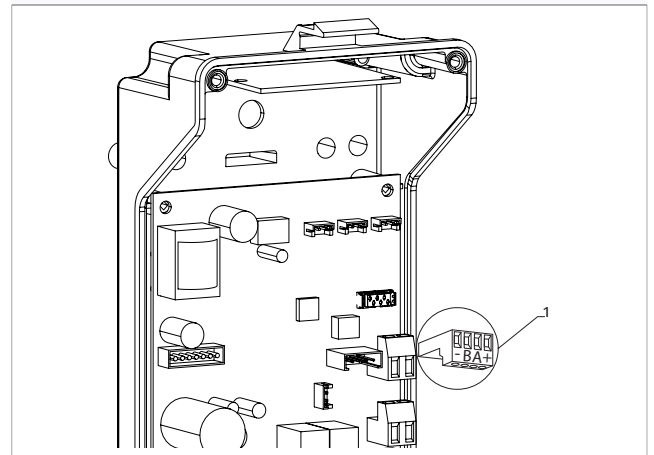

To connect the wall control panel to the board:

- connect the power supply cables to a 12 V-dc power supply

8.5.3 Presence contact CP

Trough this contact it is possible connect an external device that inhibits the operation of the device, for example:

- opening window contact
- remote on/off
- infrared presence sensor
- enabling badge
- remote change of season

Function

The contact is normally open.

- when closing the CP contact, connected to a potential-free contact, the device switches to stand-by mode

CP appears on the display.

- At the touch of a button on the display the symbol ⚠ flashes.

- ⊖ It is forbidden connect in parallel the CP input to one of another electronic board. Use separate contacts.

The CP presence contact can be configured for heating and cooling operation via the "To select digital input" [p. 45](#) settings menu item (digital input).

8.5.4 Bluetooth connection






The wall-mounted remote control can be connected via Bluetooth to one or more devices, for a maximum of 16.

The devices must be equipped with an electronic board suitable for remote control.



8.6 Functions

8.6.1 Basic menu


To access the basic menu

- with the display off, hold down  for 10 seconds
The device turns on and  appears
- keep pressed until the indication  appears
- release the  key
The symbol  appears


To navigate in the menu


- use the icons  

To select a menu item and to confirm the changes made

- press the icon 
Confirming the change takes you to the next item.

To exit the menu

- press the icon  for 10 seconds
- or wait 30 seconds the automatic shutdown

 After 30 seconds from the last action the control goes out and the settings is memorized.

Menu items

ot: AIR probe offset (air probe setting)

ur: Value read by the R.H. sensor

ut: Probe Offset PT4

uS: Humidity setpoint

ui: Humidity hysteresis

CF: Scale






ub: Buzzer volume

uu: Not used


uP: Not used

Set AIR probe offset






To set the air probe regulation

- select 
- press  to change settings
- increase or decrease the value with the icons  
- press  to confirm
*By default it is set to 0.
The setting range is from a minimum of -12.0 °C to a maximum of 12.0 °C.*

Set probe offset RH






 Modify only after real deviations from an actual measurement with professional instrumentation have been established.

To set the RH probe regulation

- select 
- press  to change settings
- increase or decrease the value with the icons  
- press  to confirm






Set the humidity setpoint

To set the humidity setpoint

- select 
- press  to change settings
- increase or decrease the value with the icons  
- press  to confirm
The setting range is from 20.0% to 90.0%.




Setting the humidity hysteresis

To set the humidity hysteresis

- select 
- press  to change settings
- increase or decrease the value with the icons  
- press  to confirm
The setting range is from 1 (min) to 30 (max).






Scale

To change the temperature unit of measure

- select 
- press  to change settings
- select °C or °F
- press  to confirm
By default the temperature unit of measure is °C.

Adjusting buzzer volume

To change the volume

- select 
- press  to change settings
- increase or decrease the value with the icons  
- press  to confirm
The volume setting range is from 00 (min) to 03 (max).





 The volume changes after confirm the modification.

8.6.2 Advanced Menu



⚠ To access the Setup menu, it is necessary to access the Basic menu. See section "Basic menu" p. 44.

The special functions menu can be accessed via the control panel.


To access the setup menu

- from the basic menu press **A**
Appears 
- press the  key once
Appears 
- press  to confirm and log in
The advanced menu is accessed.




To navigate in the menu

- use the icons  

To select a menu item and to confirm the changes made

- press  for 2 seconds
Confirming the change takes you to the next item.

To exit the menu

- press  for about 10 seconds
Appears 
- press  for about 10 seconds
The display turns off.
- or wait 30 seconds after the last action
The display is switched off automatically.

⚠ After 30 seconds from the last action the control goes out and the settings is memorized.

Menu items

AAd: Not used

Pr: Not used

of: Options for digital output

rH: Radiant heating options with R20

rC: Radiant cooling options with R20

UC: Not used

Ac: Not used




Ah: Not used

Ed: Not used


Fr: Not used

To select digital input

To change the digital input

- select  **i**
- press  to change settings
- select CP for contact presence (default)
- select CO to cooling open
- select CC to cooling close
- press  to confirm
By default digital input is set to CP.

⚠ For return to the default settings, set the digital input to "CP".

⚠ By selecting one of the other inputs (CO,CC) the seasonality is locked. It is not possible to modify it through the key  of the control.

Set radiant options in heating with R20

⚠ To change the rH function, it is necessary to have the accessory MZS - Single zone module for radiant system, code EG1028II.

⚠ To change the settings, please refer to the Instruction Sheet of the accessory MZS - Single zone module for radiant system, code EG1028II.



Set radiant options to cooling with R20

⚠ To change the rC function, it is necessary to have the accessory MZS - Single zone module for radiant system, code EG1028II.


⚠ To change the settings, please refer to the Instruction Sheet of the accessory MZS - Single zone module for radiant system, code EG1028II.

8.6.3 Pairing of control and unit

To pair the control with the unit

- with control switched on, at the same time press  and  for about 10 seconds
In the display area, where the setpoint is indicated, appears the number of connected devices.
The displayed value flashes.


1. Red LED
2. Green LED
3. Black button
4. Electrical box

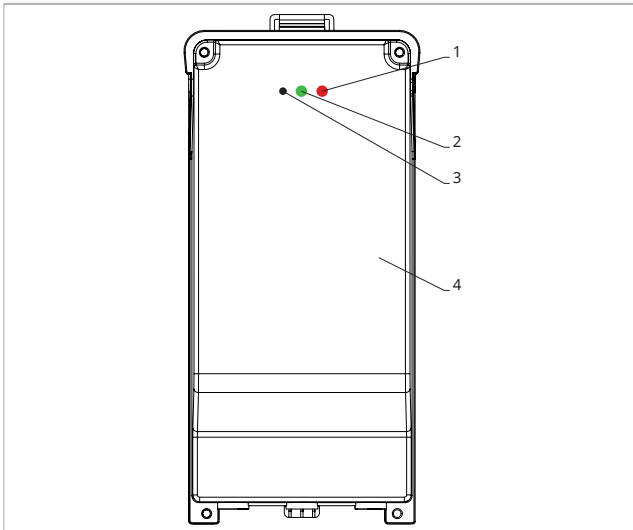

On the electrical box on the unit





- press the black button for 3 seconds
The green LED flashes.
The red LED is on.
- wait for the procedure to complete
The green LED stops flashing.

On the wall mounted control panel








- Appear the number assigned to the fancoil.
Then appears the number of connected devices.
- press  to exit the menu

⚠ To reset the pairing settings, it is first necessary to access the basic menu. See section "Basic menu" .



To reset pairing settings

- access the basic menu
- press 
- press 
- All the way to the  menu.
- press 








To reset a single fancoil

- Appears 
- press 
- Appears 
- press  to log in
- use the  icons to move inside the menu
The assignment numbers assigned to the fancoils appear.
- select the fancoil to be reset
- press  to confirm
 appears, with an acoustic signal.
The device is removed.

To exit the setting

- press  for 5 seconds
Exit the  setting.
Back to menu 02.

To reset all fancoils

- Appears 
- press  until  appears
Appears 
- press  to confirm
- use the  icons to move inside the menu
- select No to maintain all fancoils
- select Yes to reset the fancoils
- press  to confirm

LED interface operation on the electrical box

If the device is in provisioning

The green LED flashes.

If the device is provided and functioning

The green LED is on.

If the device has not been provisioned and is not functional

The green LED is off.
The red LED is on.

If the device is in alarm status

The red LED flashes.


⚠ The red LED flashes according to the type of alarm. To check the alarm type, please refer to the following "Error signals" section.

If communication with the remote control is missing

The green and red LEDs will flash once every second.

8.6.4 Error signals

The PCB has a status LED.

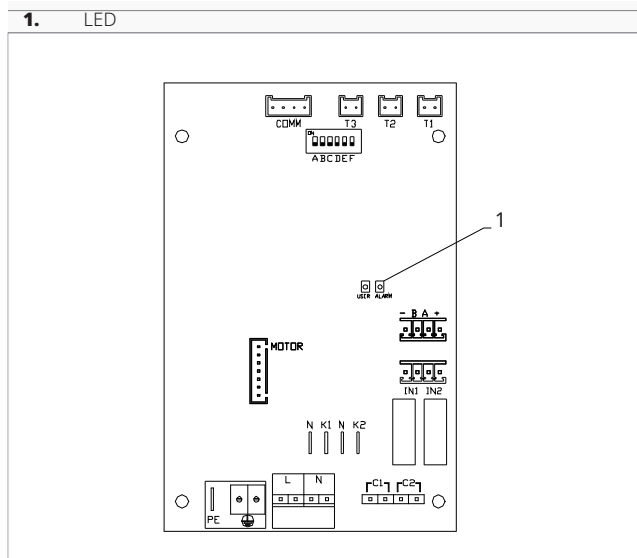

⚠ Once the pairing has been completed, the red LED on the cover of the electrical box performs the same functions as the LED on the board on the unit.

⚠ The flashing LED indicates errors.


⚠ With the LED on, it is indicated that there aren't errors.

LED signals

- Led flashing
Errors to be shown on the display.
- LED off
Remote control switched off.
- LED continuous flashing with pause between flashes
Unsuitable water temperature alarm.
- LED on
Wall control panel on and no alarm.
- LED 2 flashes / pause
Internal fan motor alarm faulty or disconnected.
- LED 3 flashes / pause
Alarm for water temperature probe H2/T2 disconnected or faulty.
- LED 6 flashes / pause
Communication error alarm with wall control panel.





8.6.5 Visualization of alarms on display

⚠ In the event of an alarm, the device still maintains active functions.

⚠ The symbol  is displayed to indicate alarms on the wall control panel.

⚠ **To access the Setup menu, it is necessary to access the Basic menu. See section "Basic menu" p. 44.**

To visualise errors on the wall control panel

- access the basic menu
 - press 
Appears .
 - press  to confirm
Appears .
- Then the number assigned to the fancoil appears and then the error is displayed.*

Displayed alarms

- E2 Faulty internal fan motor or disconnected
None of the modes can be activated.
- E3 Water temperature probe H2/T2 disconnected or failure
None of the modes can be activated.
- E5 H4/T3 heating water probe disconnected or faulty
None of the modes can be activated.
- E6 Incorrect water temperature with automatic season function setting
The fancoil is performing heating and cooling functions incorrectly. None of the unit's functions can be activated.
- E7 Module Communication Alarm
Bluetooth communication not functioning.
- E8 Communication error
Communication error between the wall control panel and the fancoil.
- h2o Incorrect water temperature
*In heating mode, the water temperature is below 30 °C.
In cooling mode, the water temperature is above 20 °C.*


⚠ Errors E7 and E8 are displayed without the error display procedure on the wall control panel.

⚠ Alarm E7 is an error that only appears with the control panel for wall control with Bluetooth connection (Code EGB749II).

ON-BOARD ELECTRONIC BOARD B4V642 + WALL CONTROL B3V151

9.1 Interface

Wall mounted control with thermostat, summer/winter and speed selectors.

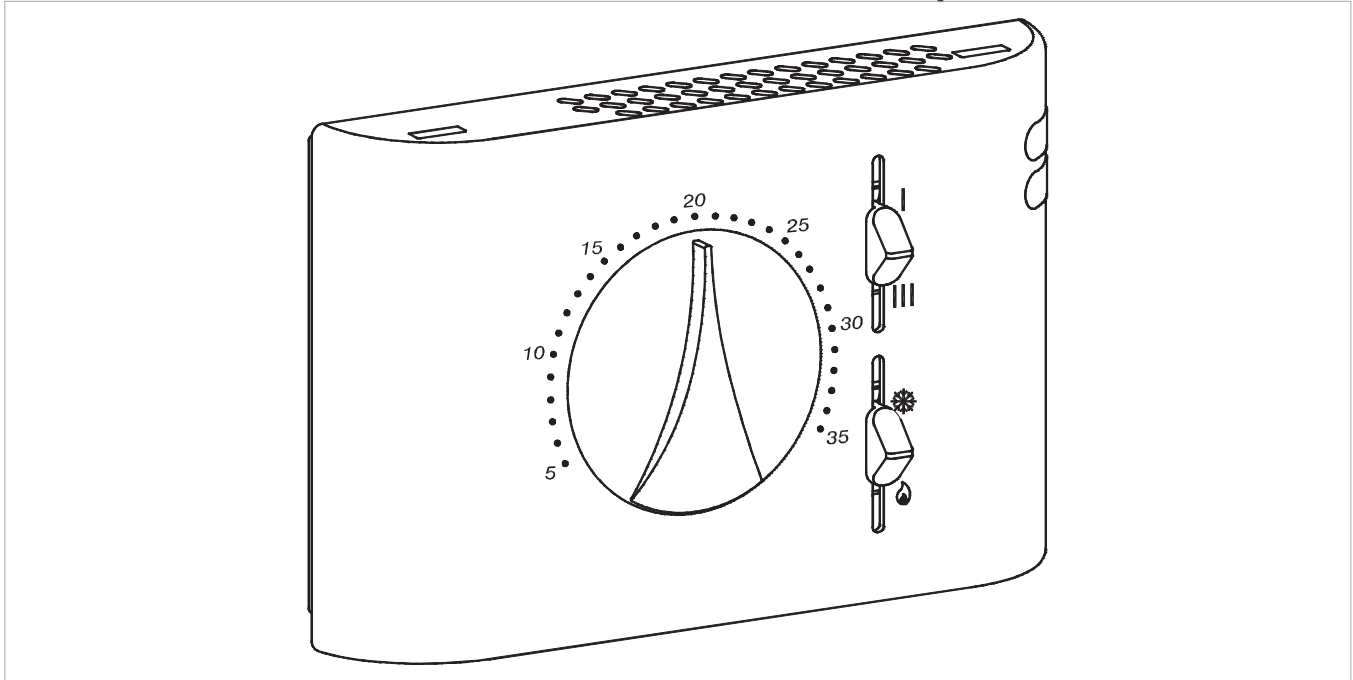

9.2 Description


Wall mounted control with thermostat, summer/winter and speed selectors, in connection with B4V842II.

⚠ For 2 pipe units

9.3 Connection diagram

L-N	230 V/50 Hz electrical power supply connection
EV	Solenoid valve permission input
V1	Maximum fan speed
V2	Medium fan speed
V3	Velocità minima ventilatore
V4	Supersilent speed
Y2	Full-flat connection (voltage output at 230 V/50 Hz 1 A)


Y1	Water solenoid valve (230 V/50 Hz 1 A power output)
HRS	Water temperature probe 10 kΩ for RS models
RS	Wiring for RS models
M1	Fan motor DC Inverter
H2	Hot water temperature probe 10 kΩ
H4	Water temperature probe 10 kΩ, for 4 pipes

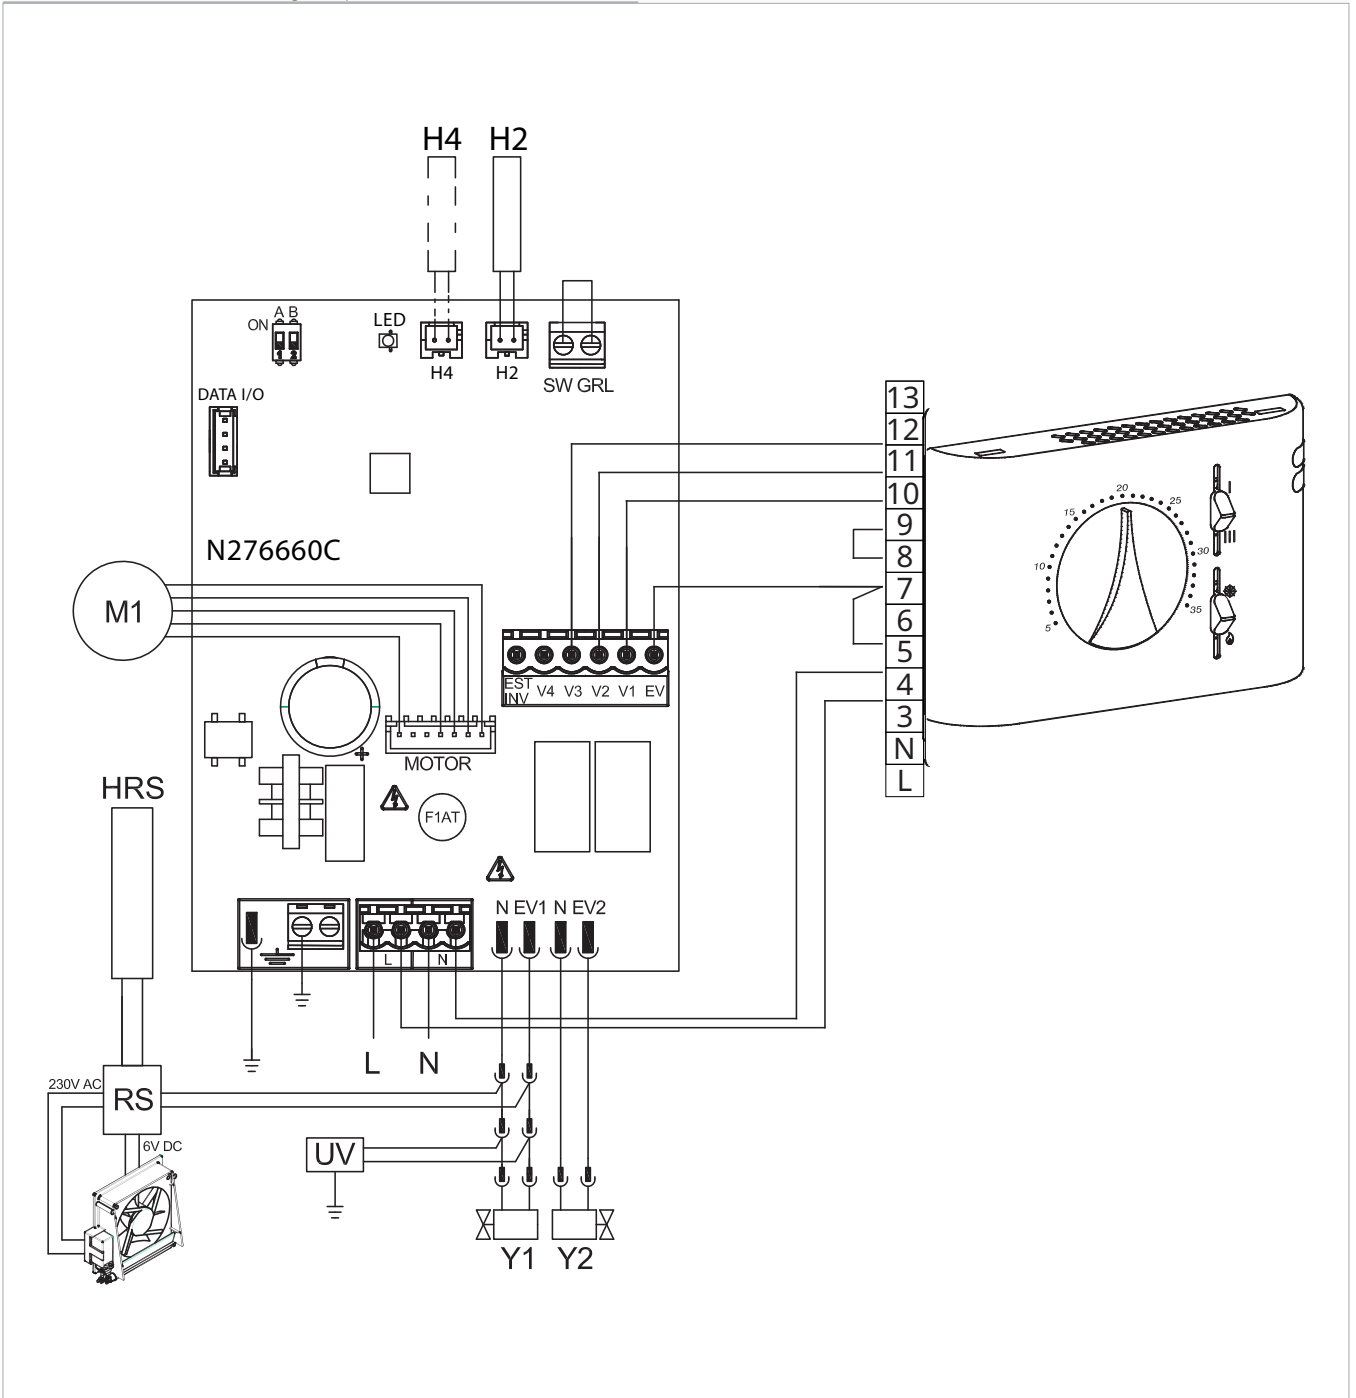

9.4 Connection diagram with seasonal switching

L-N	230 V/50 Hz electrical power supply connection
EV	Solenoid valve permission input
V1	Maximum fan speed
V2	Medium fan speed
V3	Velocità minima ventilatore
V4	Supersilent speed
Y2	Full-flat connection (voltage output at 230 V/50 Hz 1 A)


Y1	Water solenoid valve (230 V/50 Hz 1 A power output)
HRS	Water temperature probe 10 kΩ for RS models
RS	Wiring for RS models
M1	Fan motor DC Inverter
KE	Auxiliary relay (not included in supply)
H2	Hot water temperature probe 10 kΩ
H4	Water temperature probe 10 kΩ, for 4 pipes

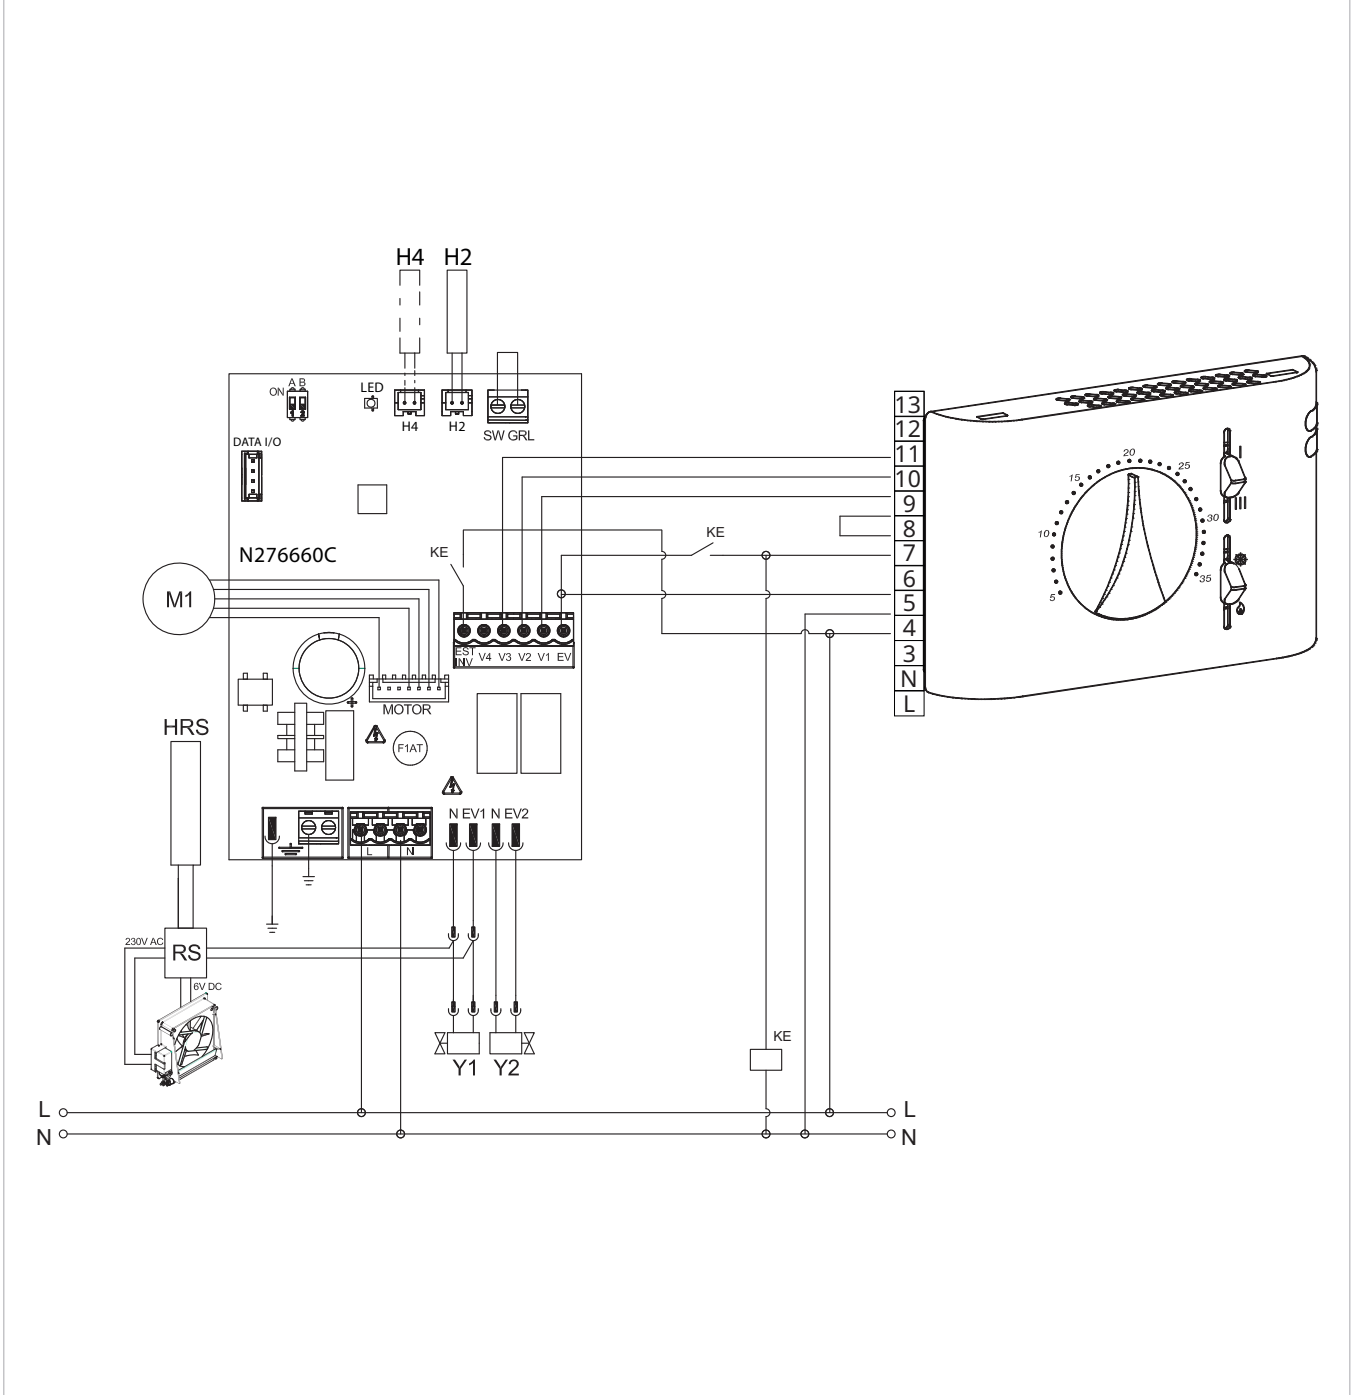

9.5 Connection diagram

L-N	230 V/50 Hz electrical power supply connection
EV	Solenoid valve permission input
V1	Maximum fan speed
V2	Medium fan speed
V3	Minimum fan speed
V4	Supersilent speed
E	Heating/cooling selection input
Y2	Full-flat connection (voltage output at 230 V/50 Hz 1 A)
Y1	Water solenoid valve (230 V/50 Hz 1 A power output)
UV	UV lamp accessory connection

HRS	Water temperature probe 10 kΩ for RS models
RS	Wiring for RS models
M1	Fan motor DC Inverter
TA	3 speed room thermostat (to buy, install and connect by the installer)
CV	Thermostat consent
SV	Speed selector
H2	Hot water temperature probe 10 kΩ
H4	Water temperature probe 10 kΩ, for 4 pipes
A	Led

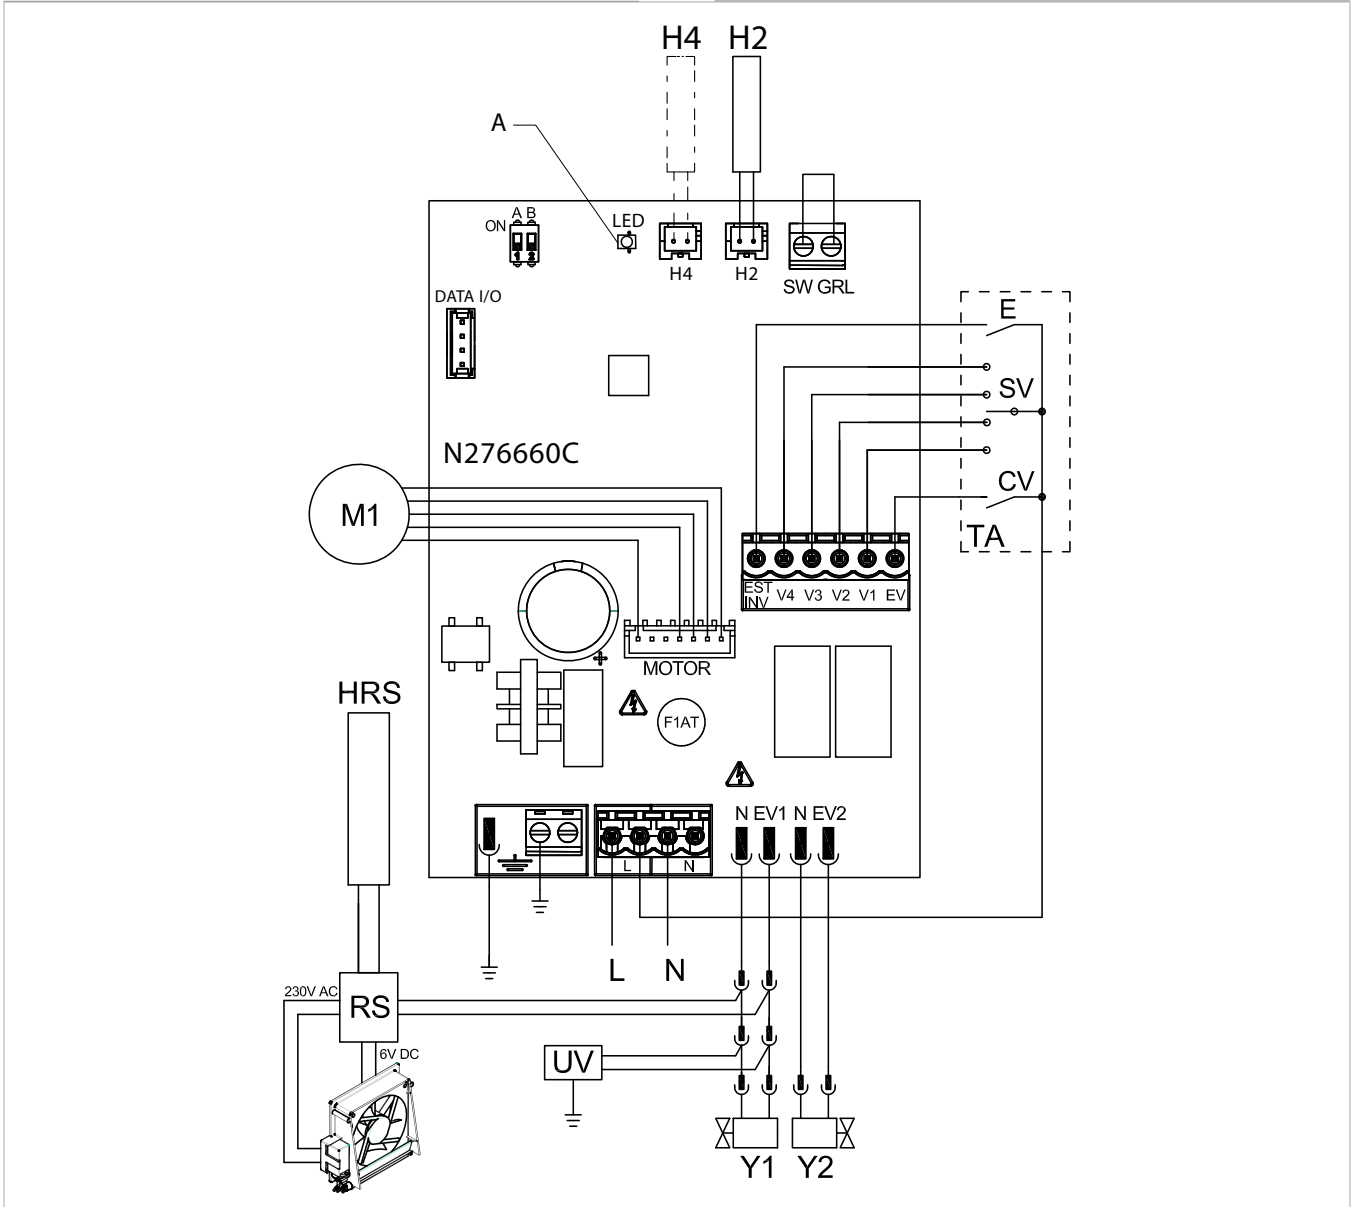

9.6 Connections

9.6.1 Connection with 3 speed thermostats

CV input

The CV input is the ON/OFF of the board.

- in case of open input, the circuit board goes into stand-by mode
- in case of closed input, the circuit board is in operation

⚠ Please refer to the sections of the electrical diagrams for connection indications.

To activate solenoid valve Y1

- Connect the CV input to the terminal L of the 230 V power supply

Speed inputs V1, V2, V3, V4

Inputs V1, V2, V3, V4 regulate the ventilation speed.

The printed circuit board has 4 speed inputs:

- V1 maximum speed (1500 rpm)
- V2 - medium speed (1100 rpm)
- V3 - minimum speed (680 rpm)
- V4 supersilent speed (550 rpm)

⚠ Connect the 3 speeds of the thermostat to three of the four available inputs based on the characteristics and use of the location.

Examples:

- to residential application where maximum silence is required, connect V2, V3 e V4
- for a residential application where heating capacity is a priority, connect V1, V2, V3

In the event of simultaneous closure of several inputs, the motor will run at a number of revolutions equal to that set by the connection with the highest speed.

⚠ You can connect several boards in parallel to a single thermostat, even using different speed.

9.7 LED signal

The PCB has a status LED.

LED signals

- LED off
CV input open. Device switched off or without power supply.
- LED on
CV input closed. Normal operation of the device.
- LED 1 flash / pause
Fan stop activation for unsuitable water. Alarm can be activated with connected water probe.
- LED 2 flashes / pause
Motor alarm (for example jamming due to foreign bodies or fault in the rotation sensor).
- LED 3 flashes / pause
Water probe alarm disconnected or faulty.

CONNECTION 0-10 V CODE B10842

10.1 Installation

10.1.1 Description

On-board electronic printed circuit board for control from systems with 0-10 V analogue output. Mounted on the unit, it allows the motor to be managed with modulating speed.

Motor regulation can be made through a 0-10 V analogue input with an input impedance of 25 kΩ.


⚠ Consider the impedance value, especially when controlling several units in parallel.

It has a 230 V output for controlling a solenoid valve.

10.2 Connection diagram

M1	Fan motor DC Inverter
PE	Earth connection
L-N	Power supply connection 230 V / 50 Hz / 1 A

Y1	Water electrovalve (voltage output 230 V / 50 Hz / 1 A)
10V	Input 0-10 V
F10	Electronic board on the machine

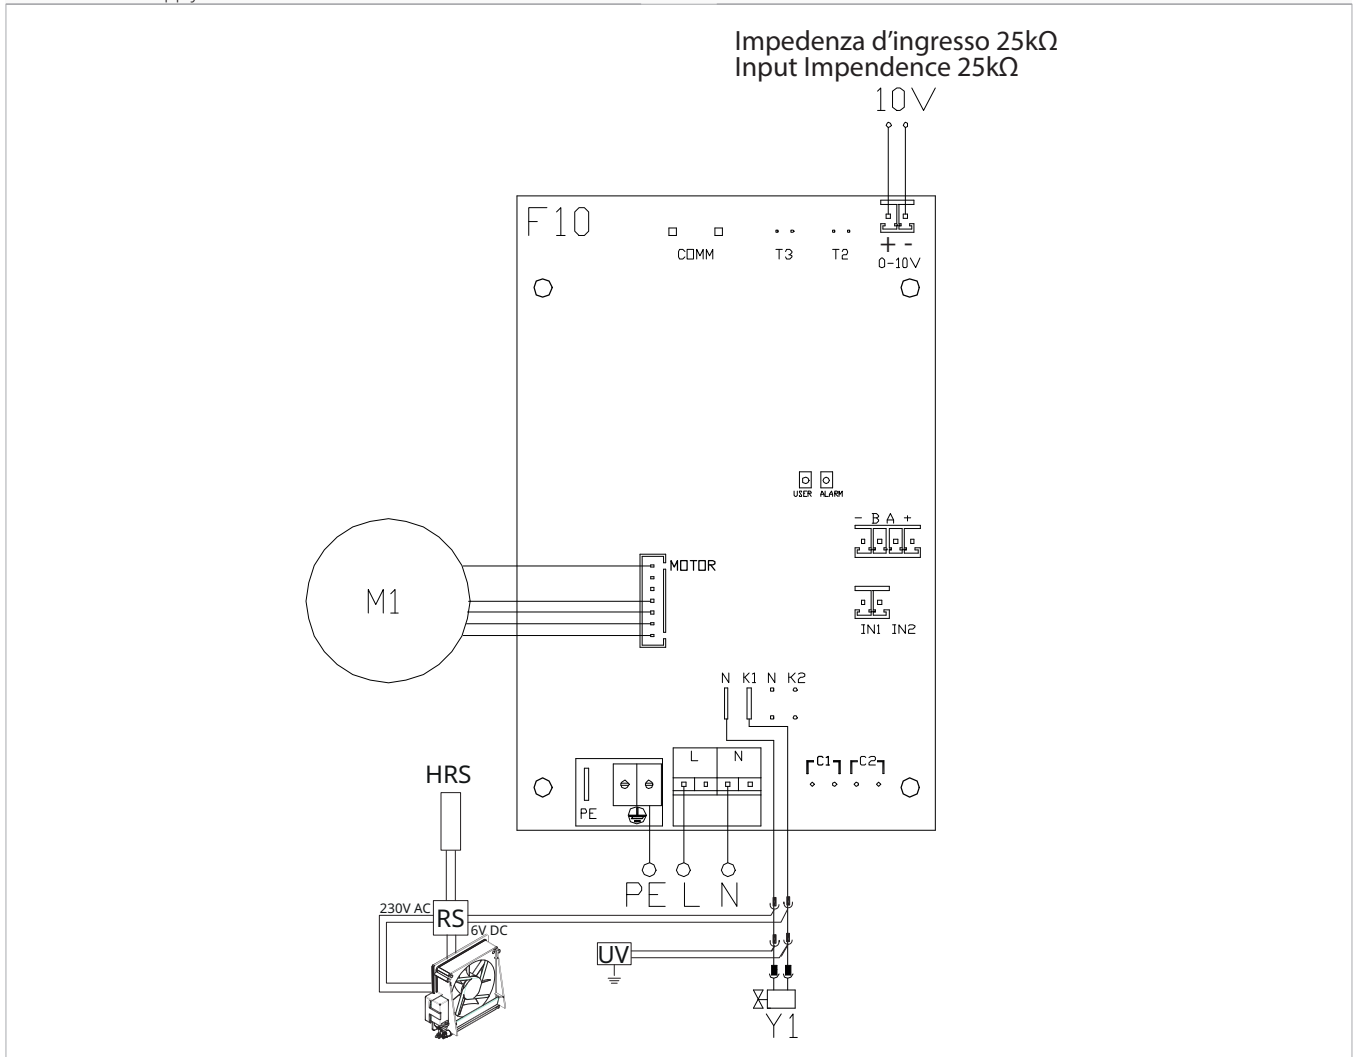

10.3 Connections with 0-10 V thermostats


With the GRID input closed, the 10 V input

- activates solenoid valve Y1

- regulates the fan speed

Linear speed regulation is possible, from a minimum value (400 rpm) to a maximum value (1500 rpm) for voltage values ≥ 1.1 V to 10 V DC.

- ⚠ The motor is switched off for values below 1 V.
- ⚠ The Y1 solenoid valve is switched on for voltage values greater than 1 V. The Y1 solenoid valve is switched off at values below 0.9 V.

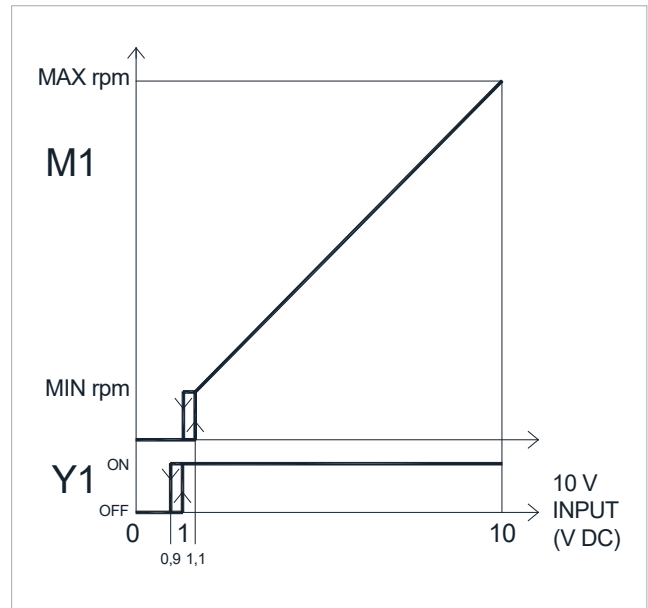

10.4 LED signal

The PCB has a status LED.

LED signals

- LED off
Input signal below 0.9 V. Device switched off or without power supply.
- LED on
Input signal more than 1 V. Normal operation of the device.
- LED frequent flashing
Activation of grille safety microswitch S1, dovuto all'operazione di pulizia filtri.
- LED 2 flashes / pause
Motor alarm (for example jamming due to foreign bodies or fault in the rotation sensor).



innova

INNOVA S.r.l.
Via I Maggio 8 - 38089 Storo (TN) - ITALY
tel. +39.0465.670104 - fax +39.0465.674965
info@innovaenergie.com